
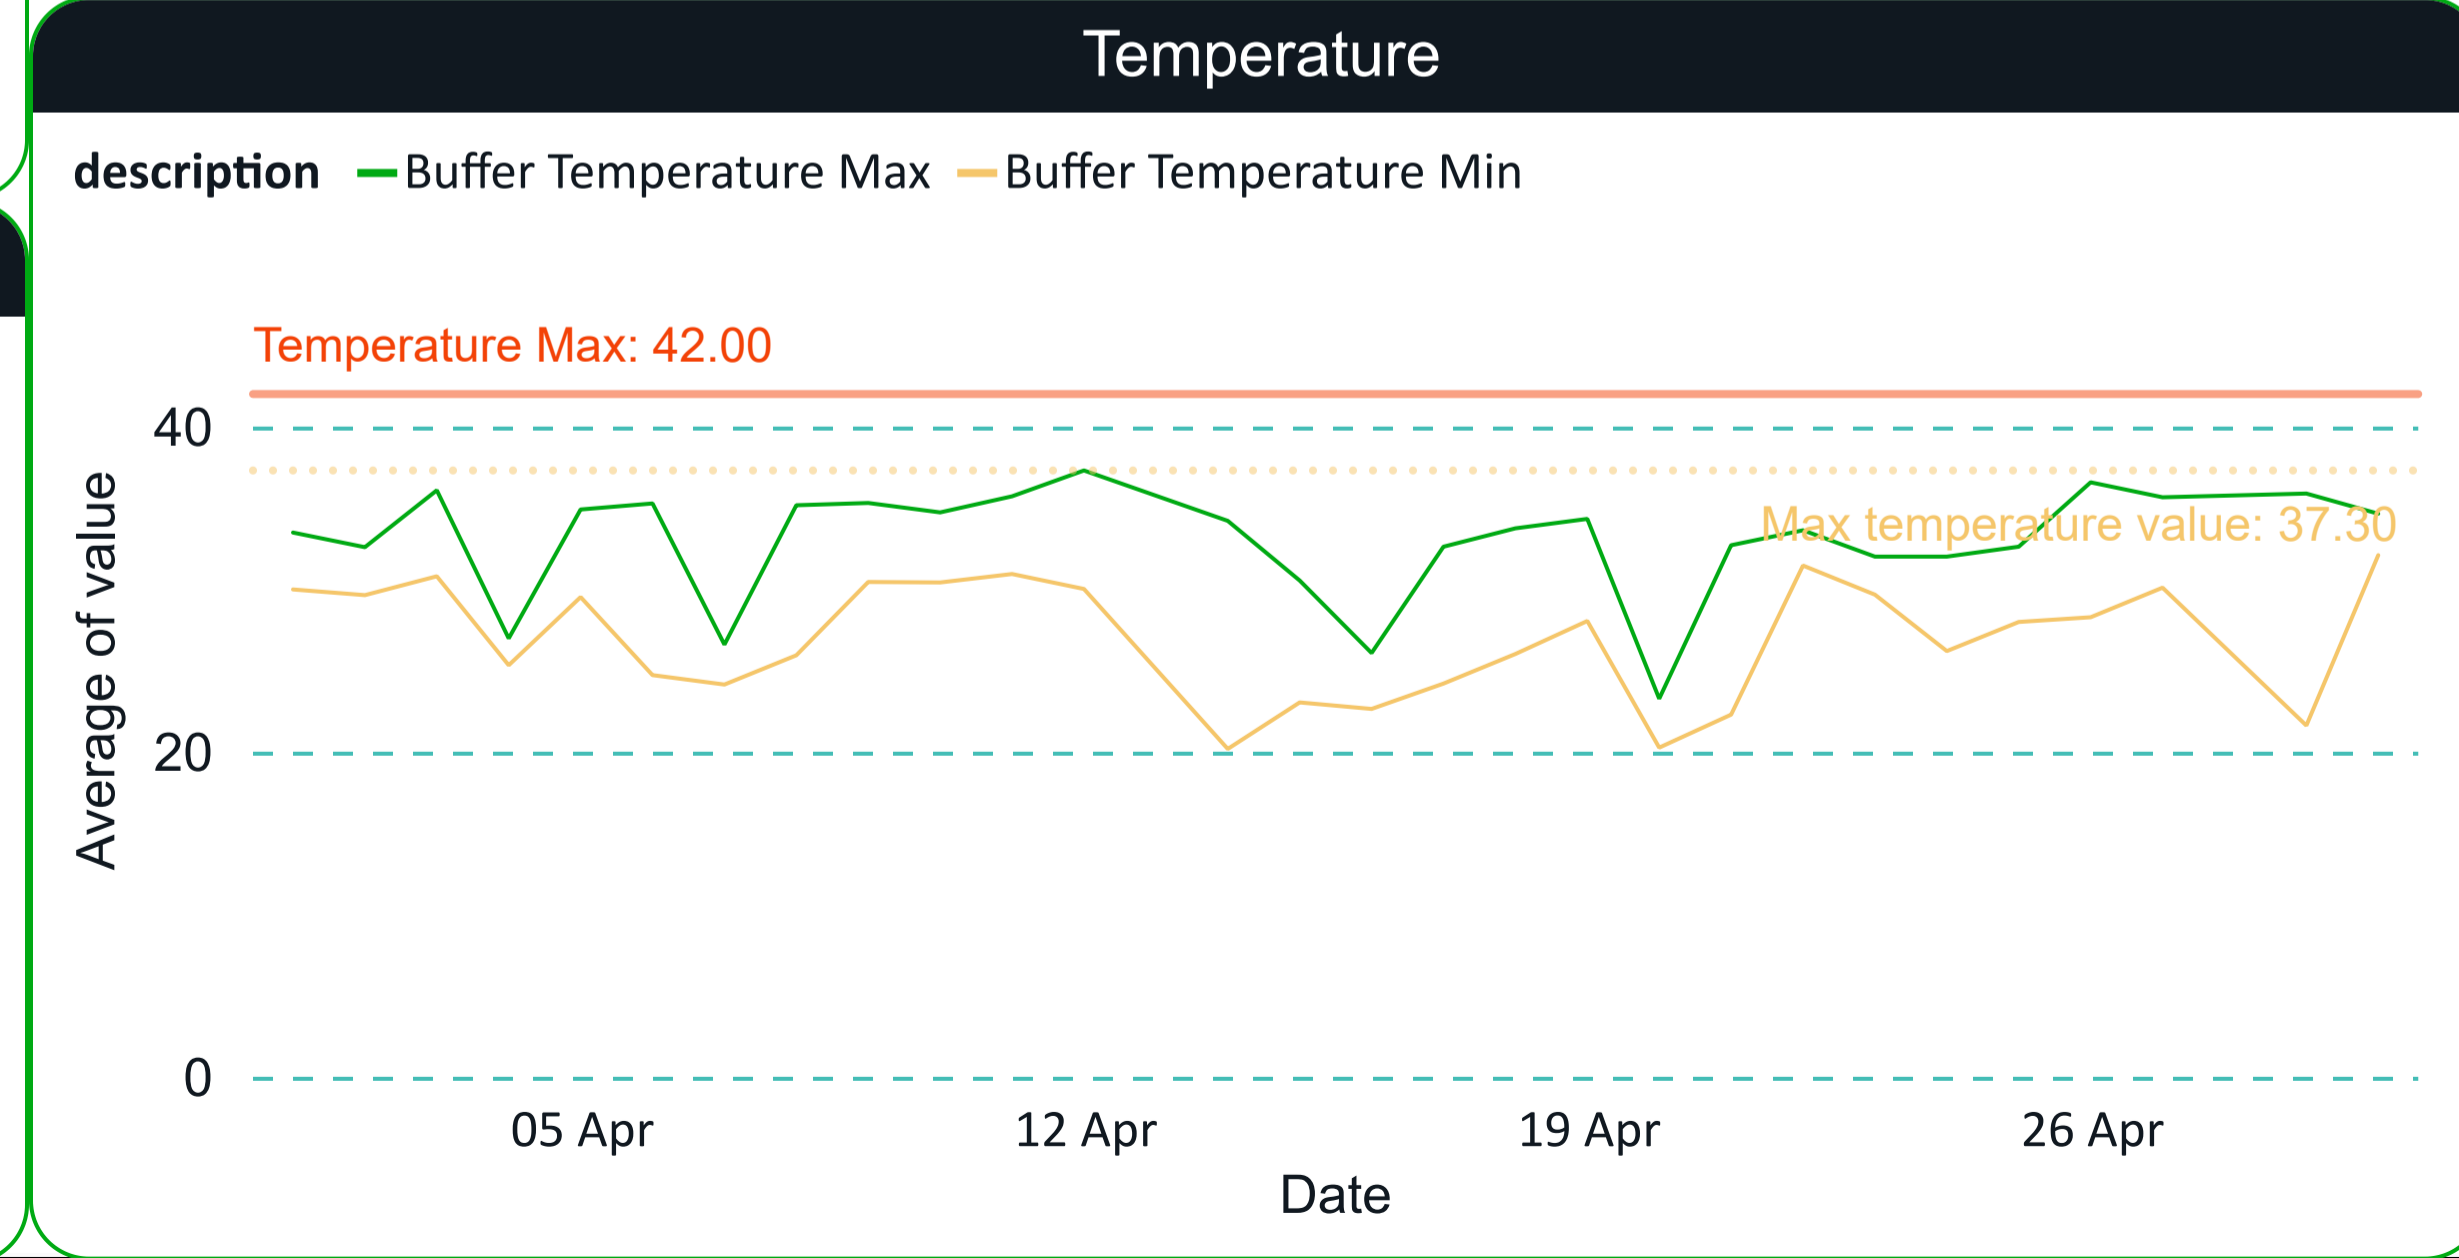
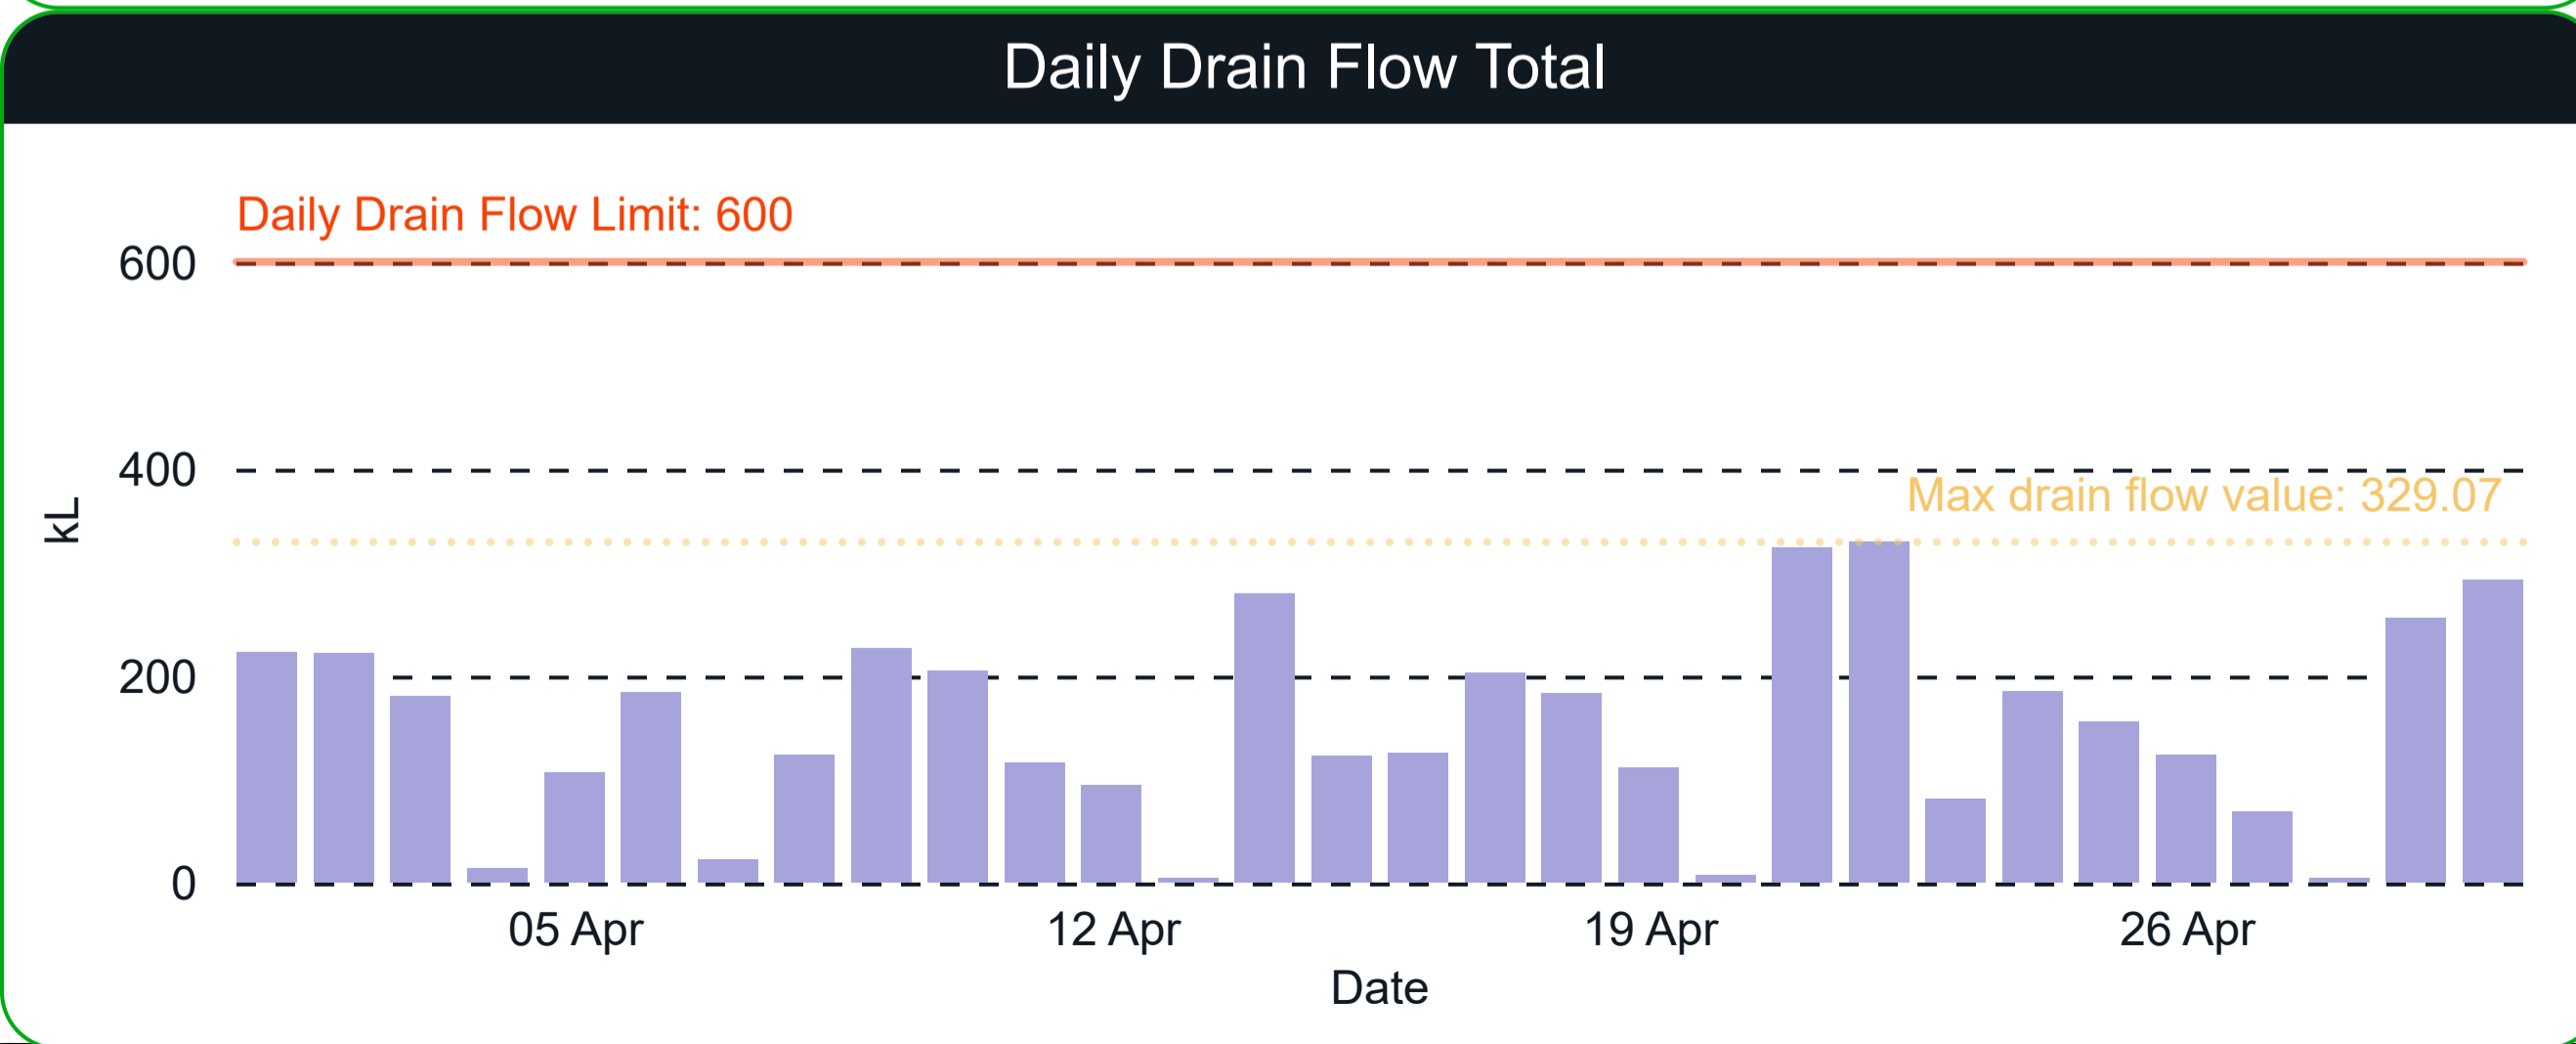


Link to License: <http://app.epa.nsw.gov.au/prpoeoapp/>

Address: Industrial Drive, Mayfield, NSW, 2304

Pollutant	Units	Frequency	Data Points	Min of Result	Max of Result	100 % limit
Temperature	degrees Celsius	Continuous	56	20.17	37.30	42
Drain Flow Total	kL/day	Daily	30	2.50	329.07	600
pH	pH	Continuous	112	7.70	8.32	6.5-8.5

Pollutant	Units	Frequency	Data Points	Min of Result	Max of Result	100 % limit
Nitrogen (ammonia)	mg/L	Monthly	1	0.99	0.99	10
Total Copper	mg/L	Monthly	1	4.00	4.00	N/A
Total Iron	mg/L	Monthly	1	0.37	0.37	2
Total Lead	mg/L	Monthly	1	3.00	3.00	30
Total Manganese	mg/L	Monthly	1	0.10	0.10	0.5
Total Suspended Solids	mg/L	Monthly	1	9.60	9.60	20
Total Zinc	mg/L	Monthly	1	0.07	0.07	1

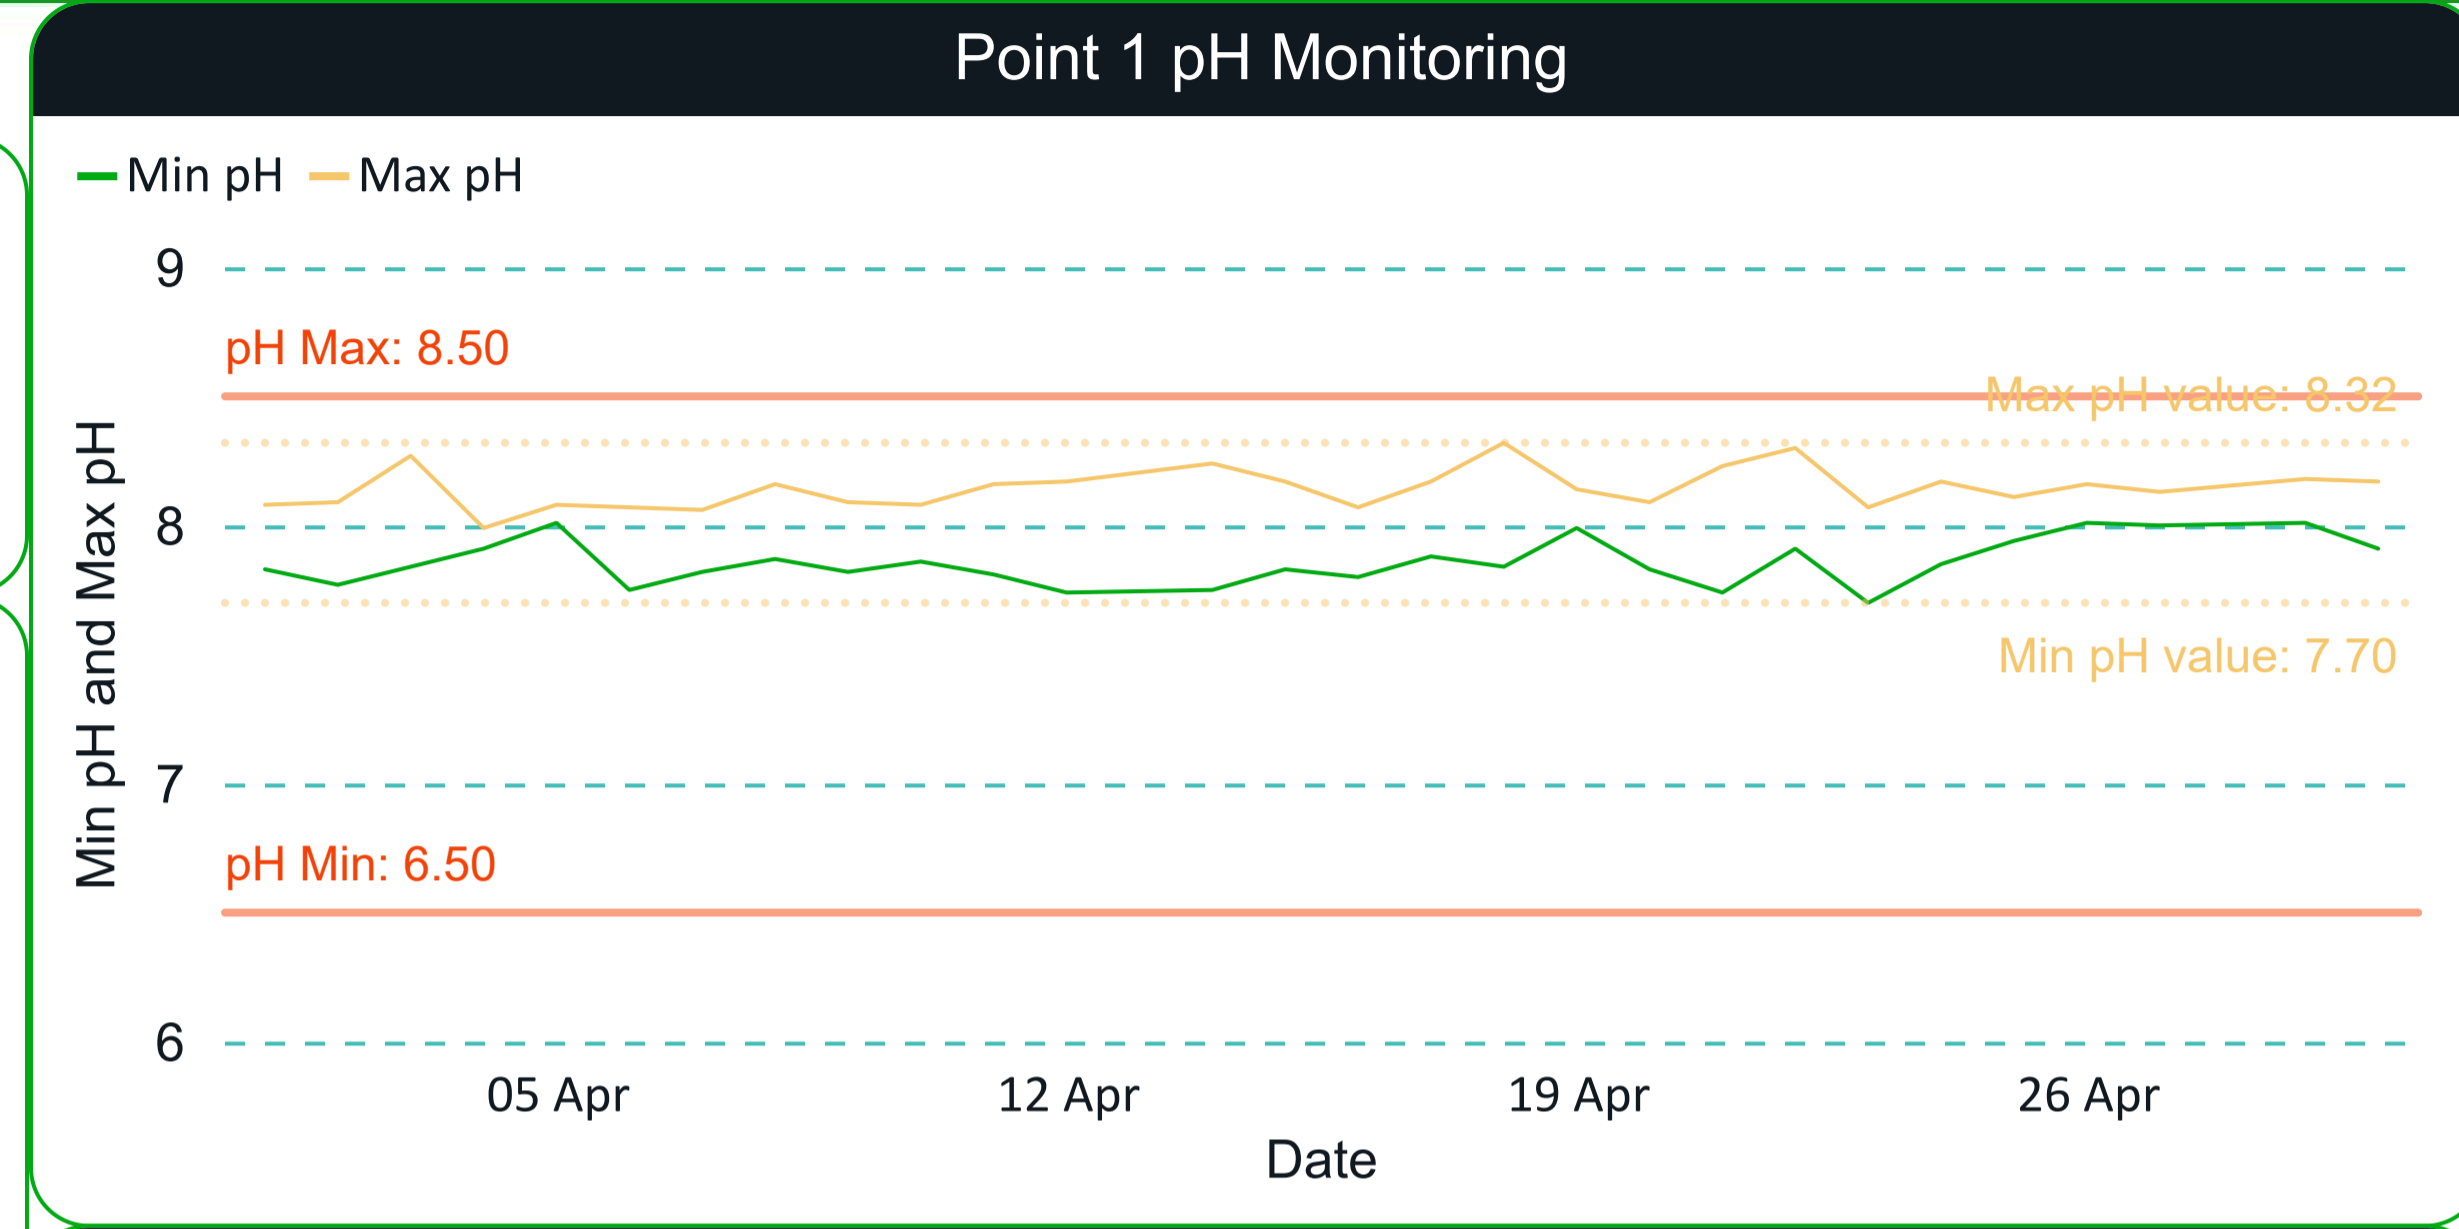

Link to License: <http://app.epa.nsw.gov.au/prpoeoapp/>

Address: Industrial Drive, Mayfield, NSW, 2304

Normal discharges

Maintenance discharges

Wet weather discharges




11





--







--




Pollutant	Units	Frequency	Data points	Min of Result	Max of Result	100 % limit
Temperature	degrees Celsius	Continuous	22	18.00	33.70	38
Volume	kL/day	Daily	11	145.50	195.80	200
pH	pH	Continuous	44	7.33	7.72	6.5-8.5

Pollutant	Units	Frequency	Data Points	Min of Result	Max of Result	100 % limit
Nitrogen (ammonia)	mg/L	Monthly	1	0.02	0.02	N/A
Oil and Grease	mg/L	Monthly	5	2.70	7.10	20
Total Iron	mg/L	Monthly	1	0.43	0.43	5
Total Manganese	mg/L	Monthly	1	0.01	0.01	0.5
Total Phosphorus	mg/L	Monthly	1	0.00	0.00	6
Total Suspended Solids	mg/L	Monthly	1	1.50	1.50	50
Total Zinc	mg/L	Monthly	1	0.17	0.17	2.5
Total Copper	ug/L	Monthly	1	3.00	3.00	N/A
Total Lead	ug/L	Monthly	1	0.00	0.00	N/A

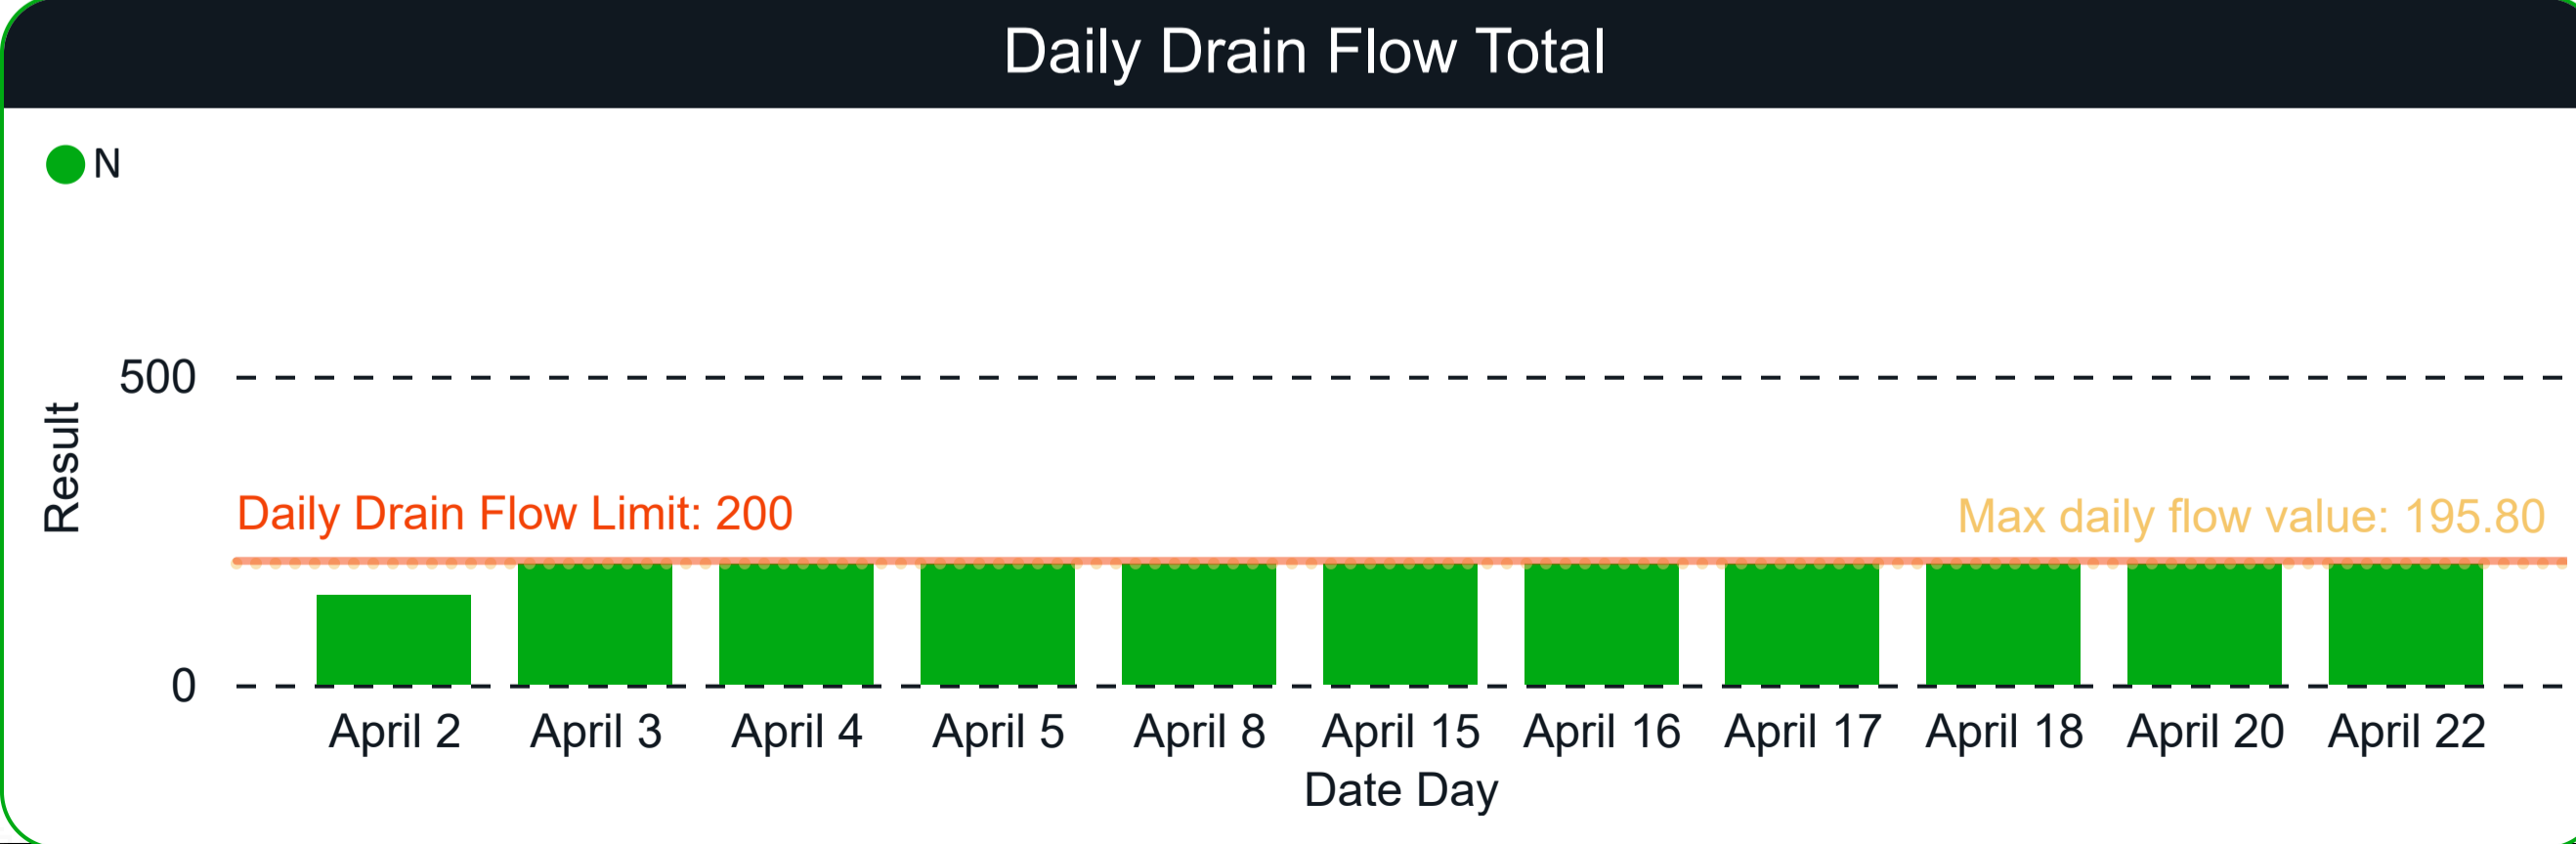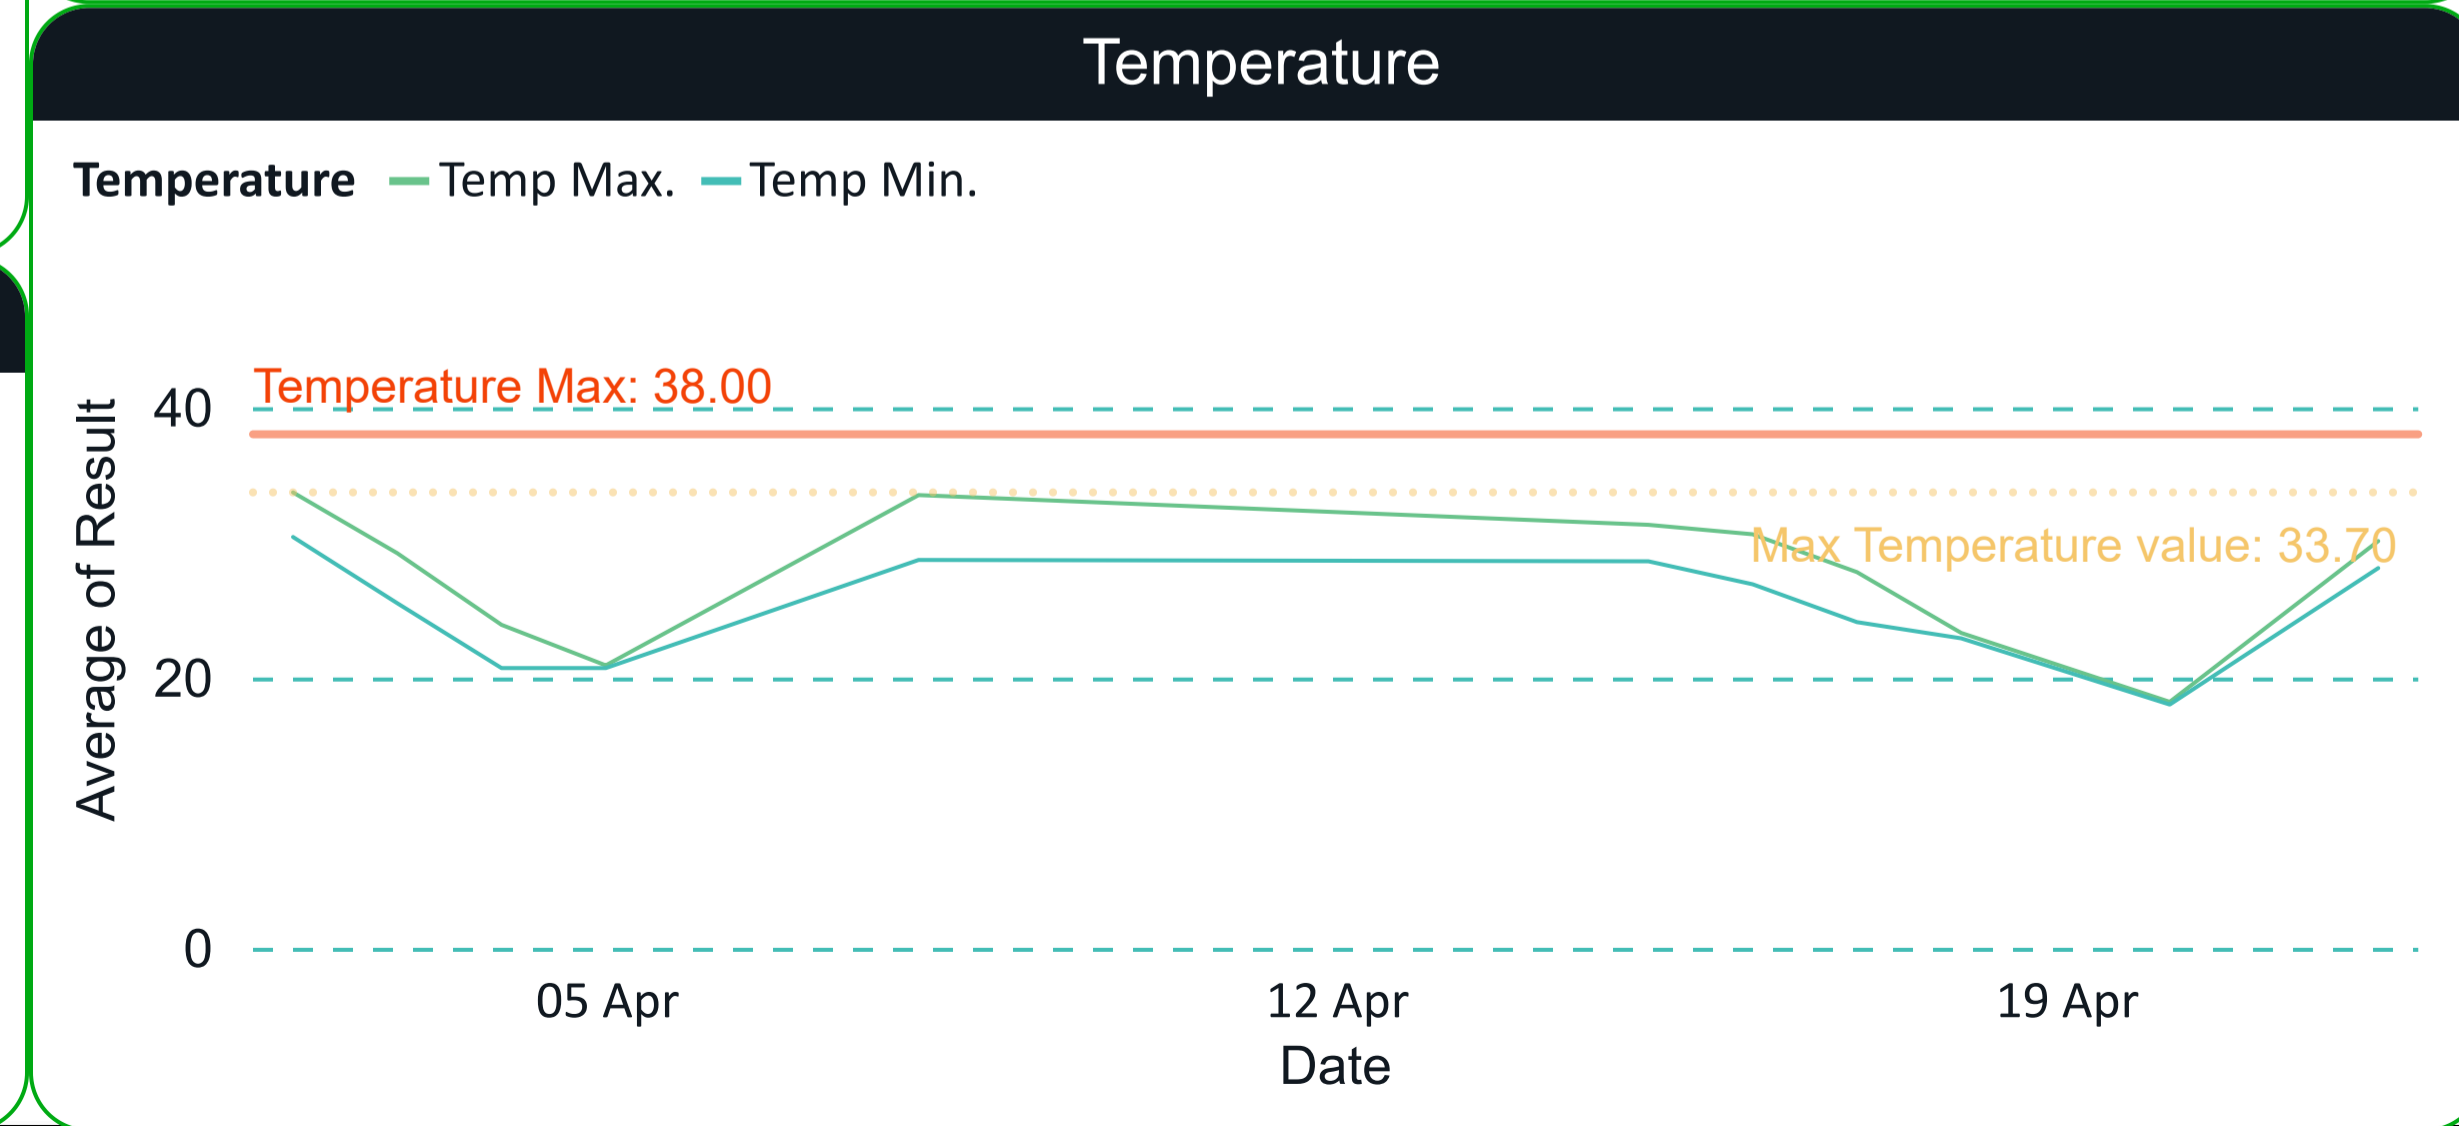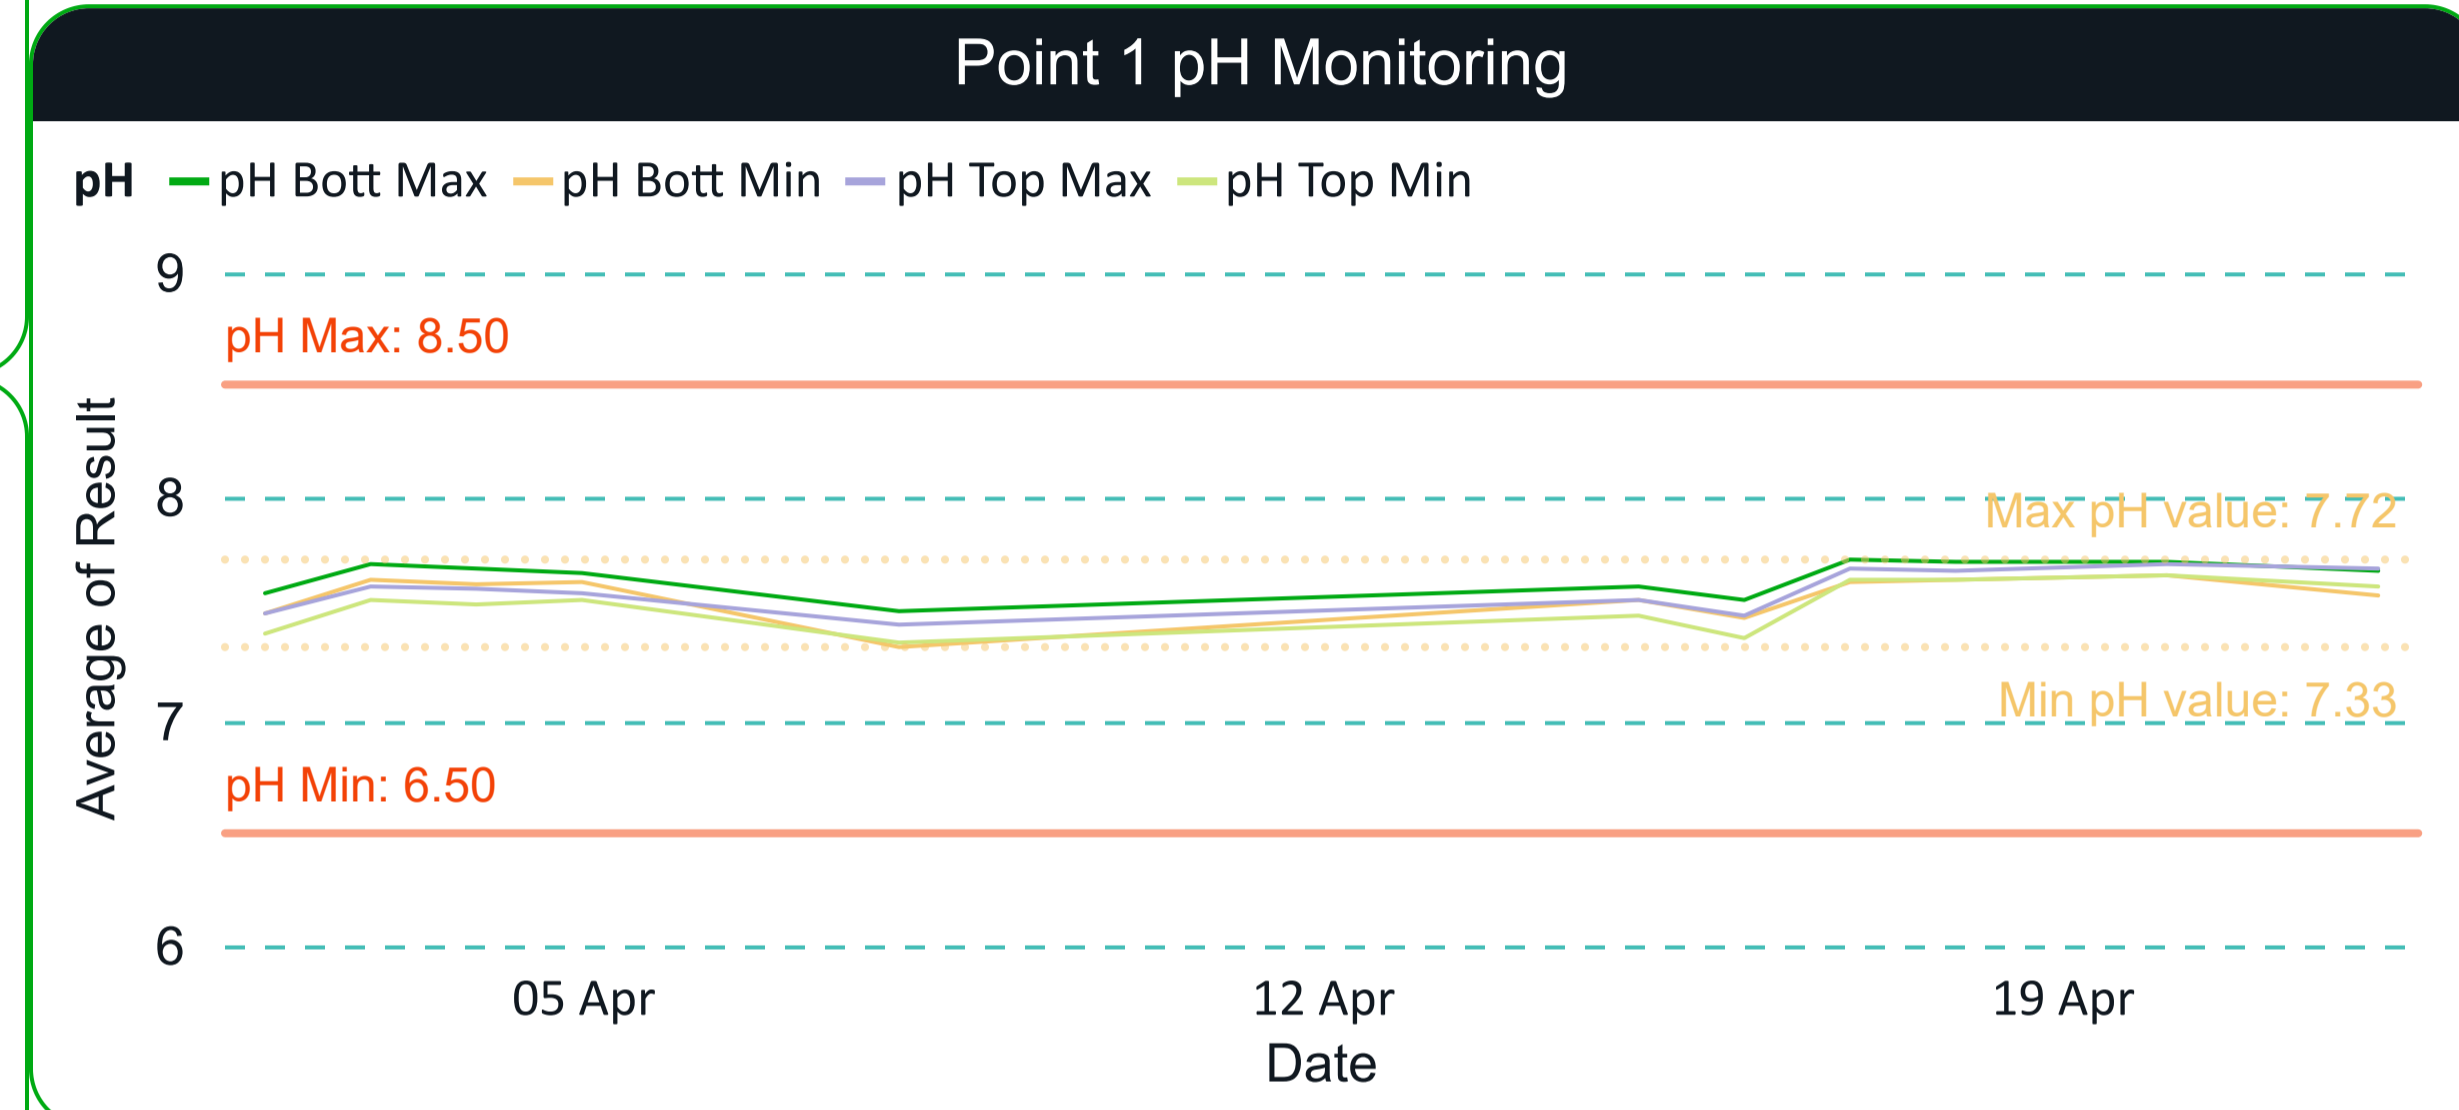

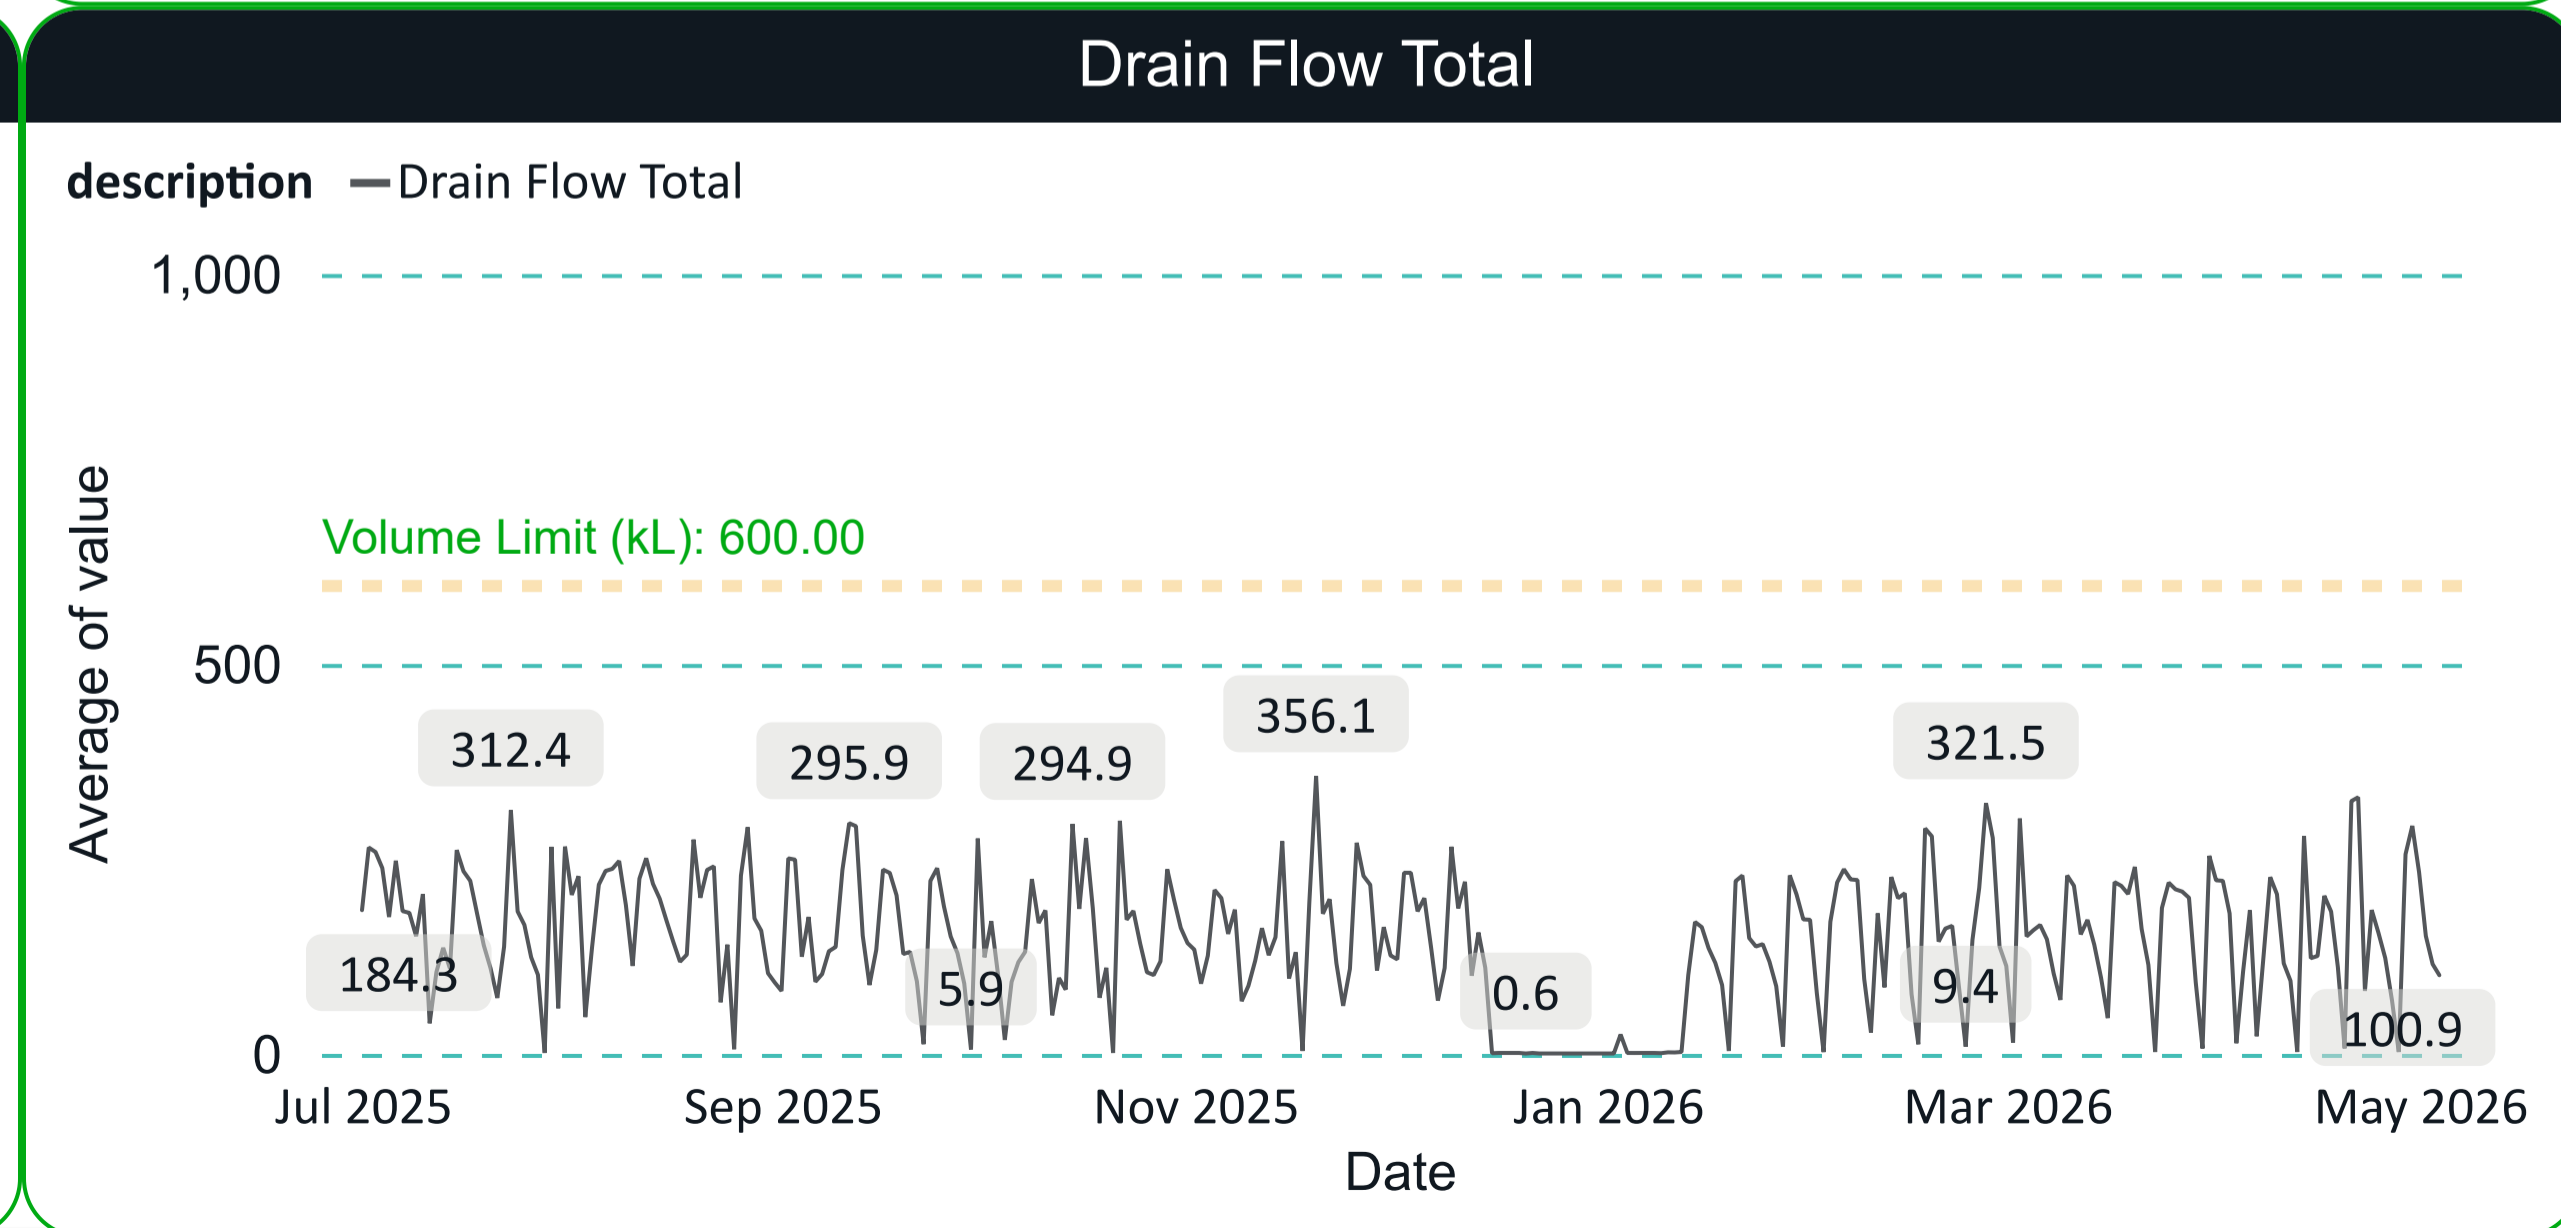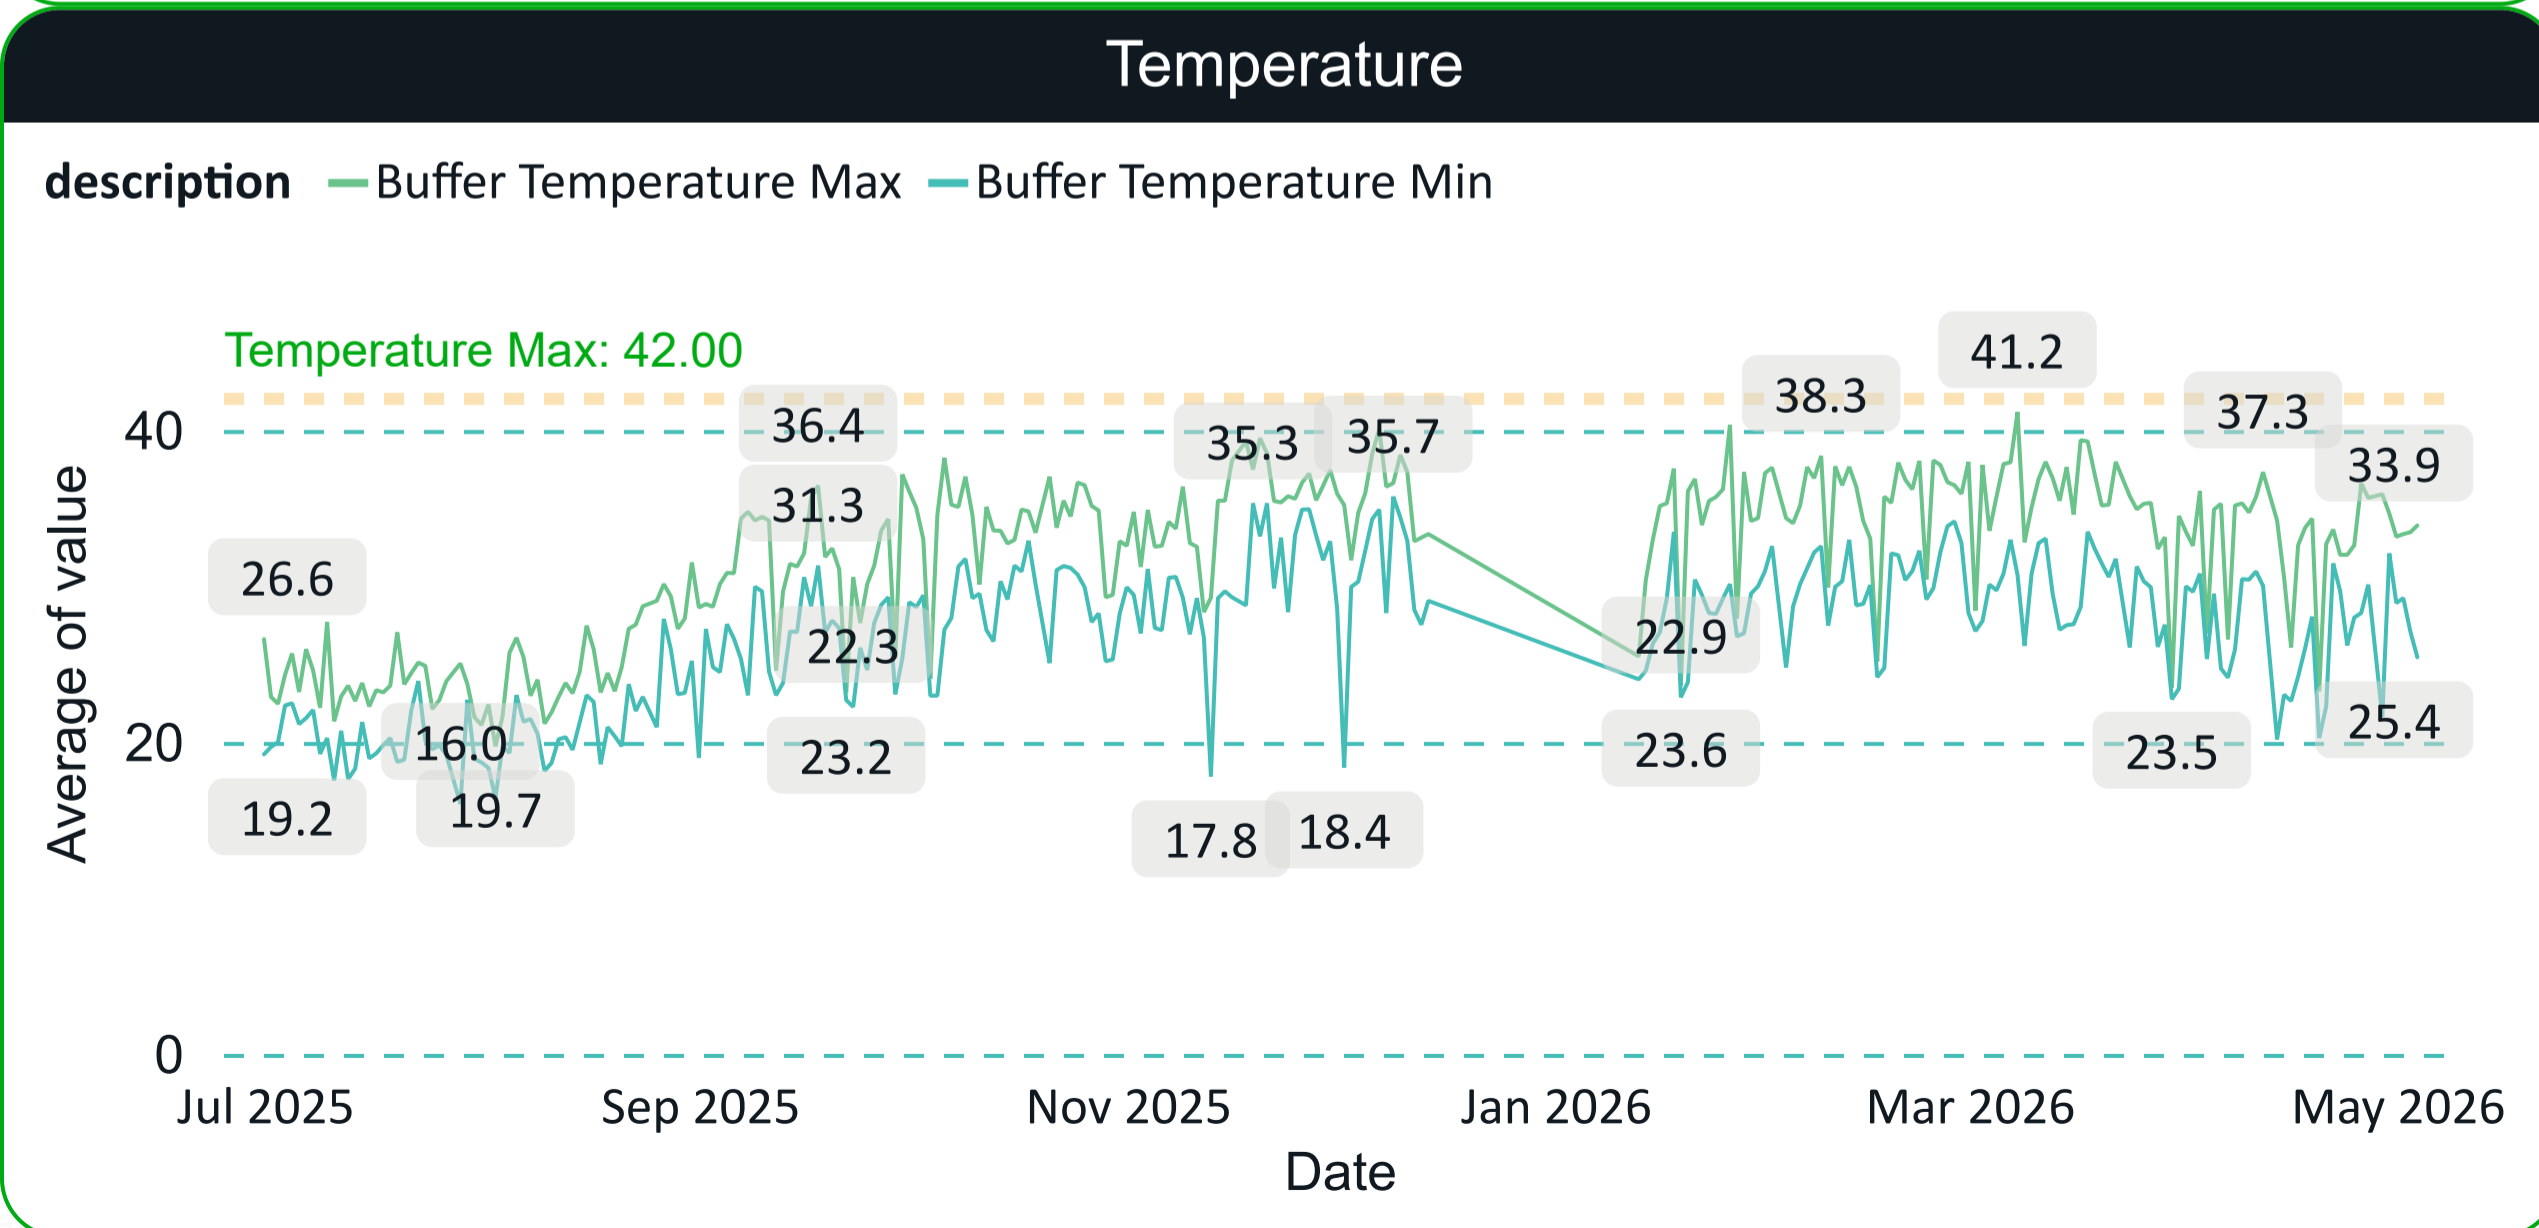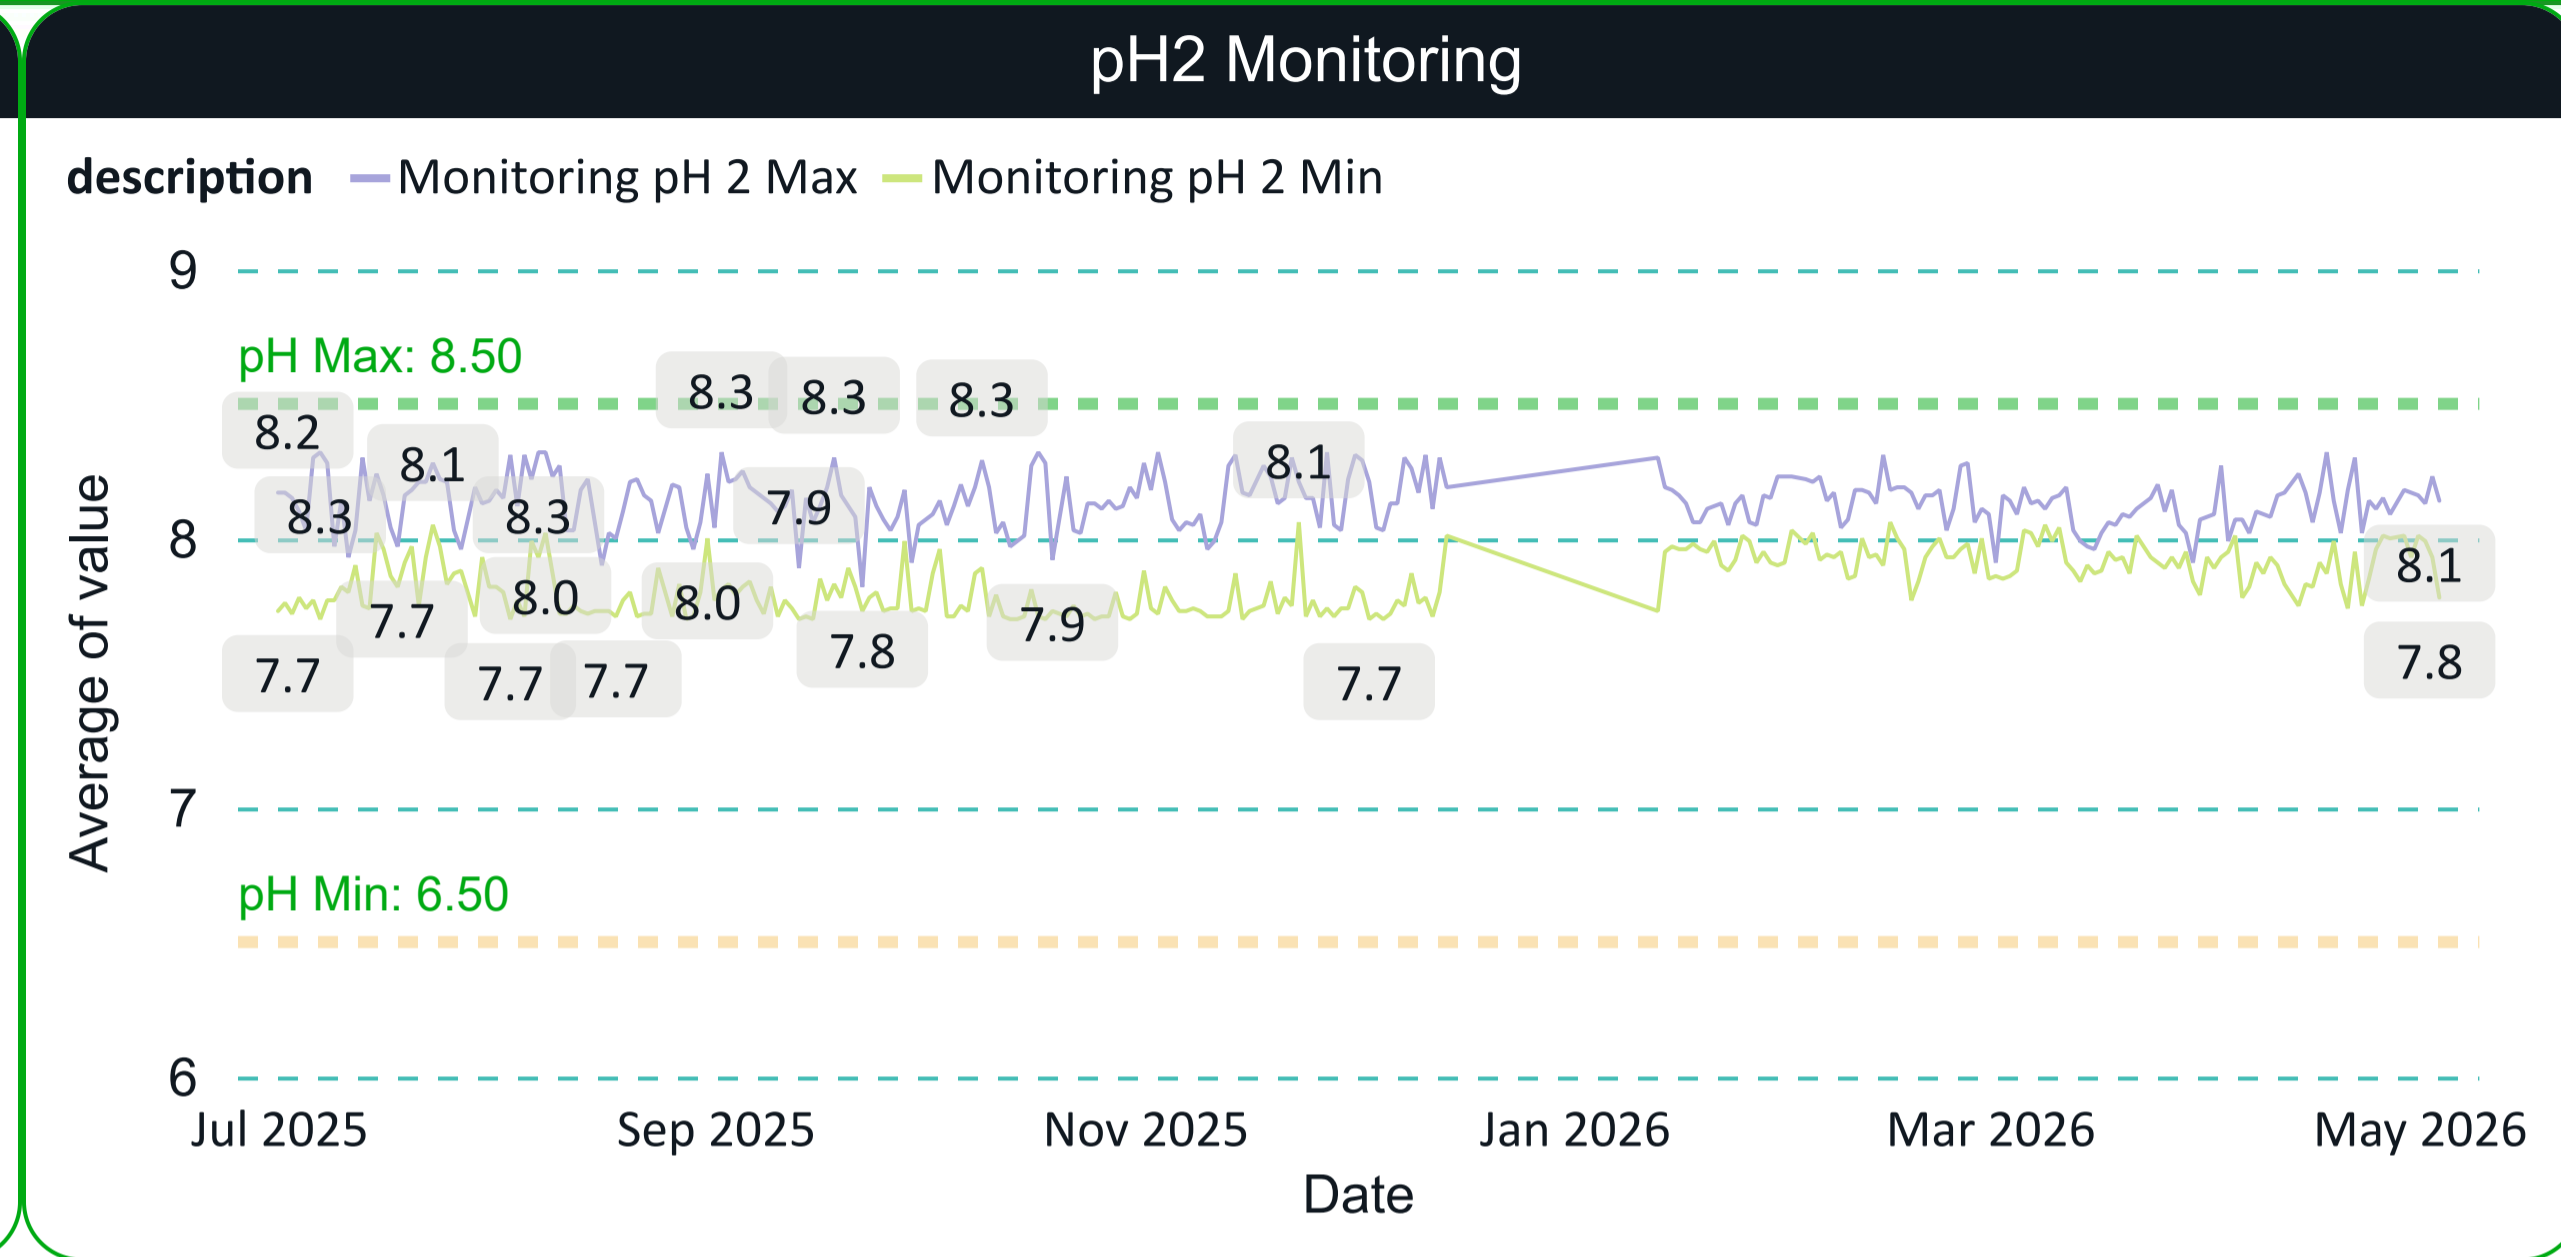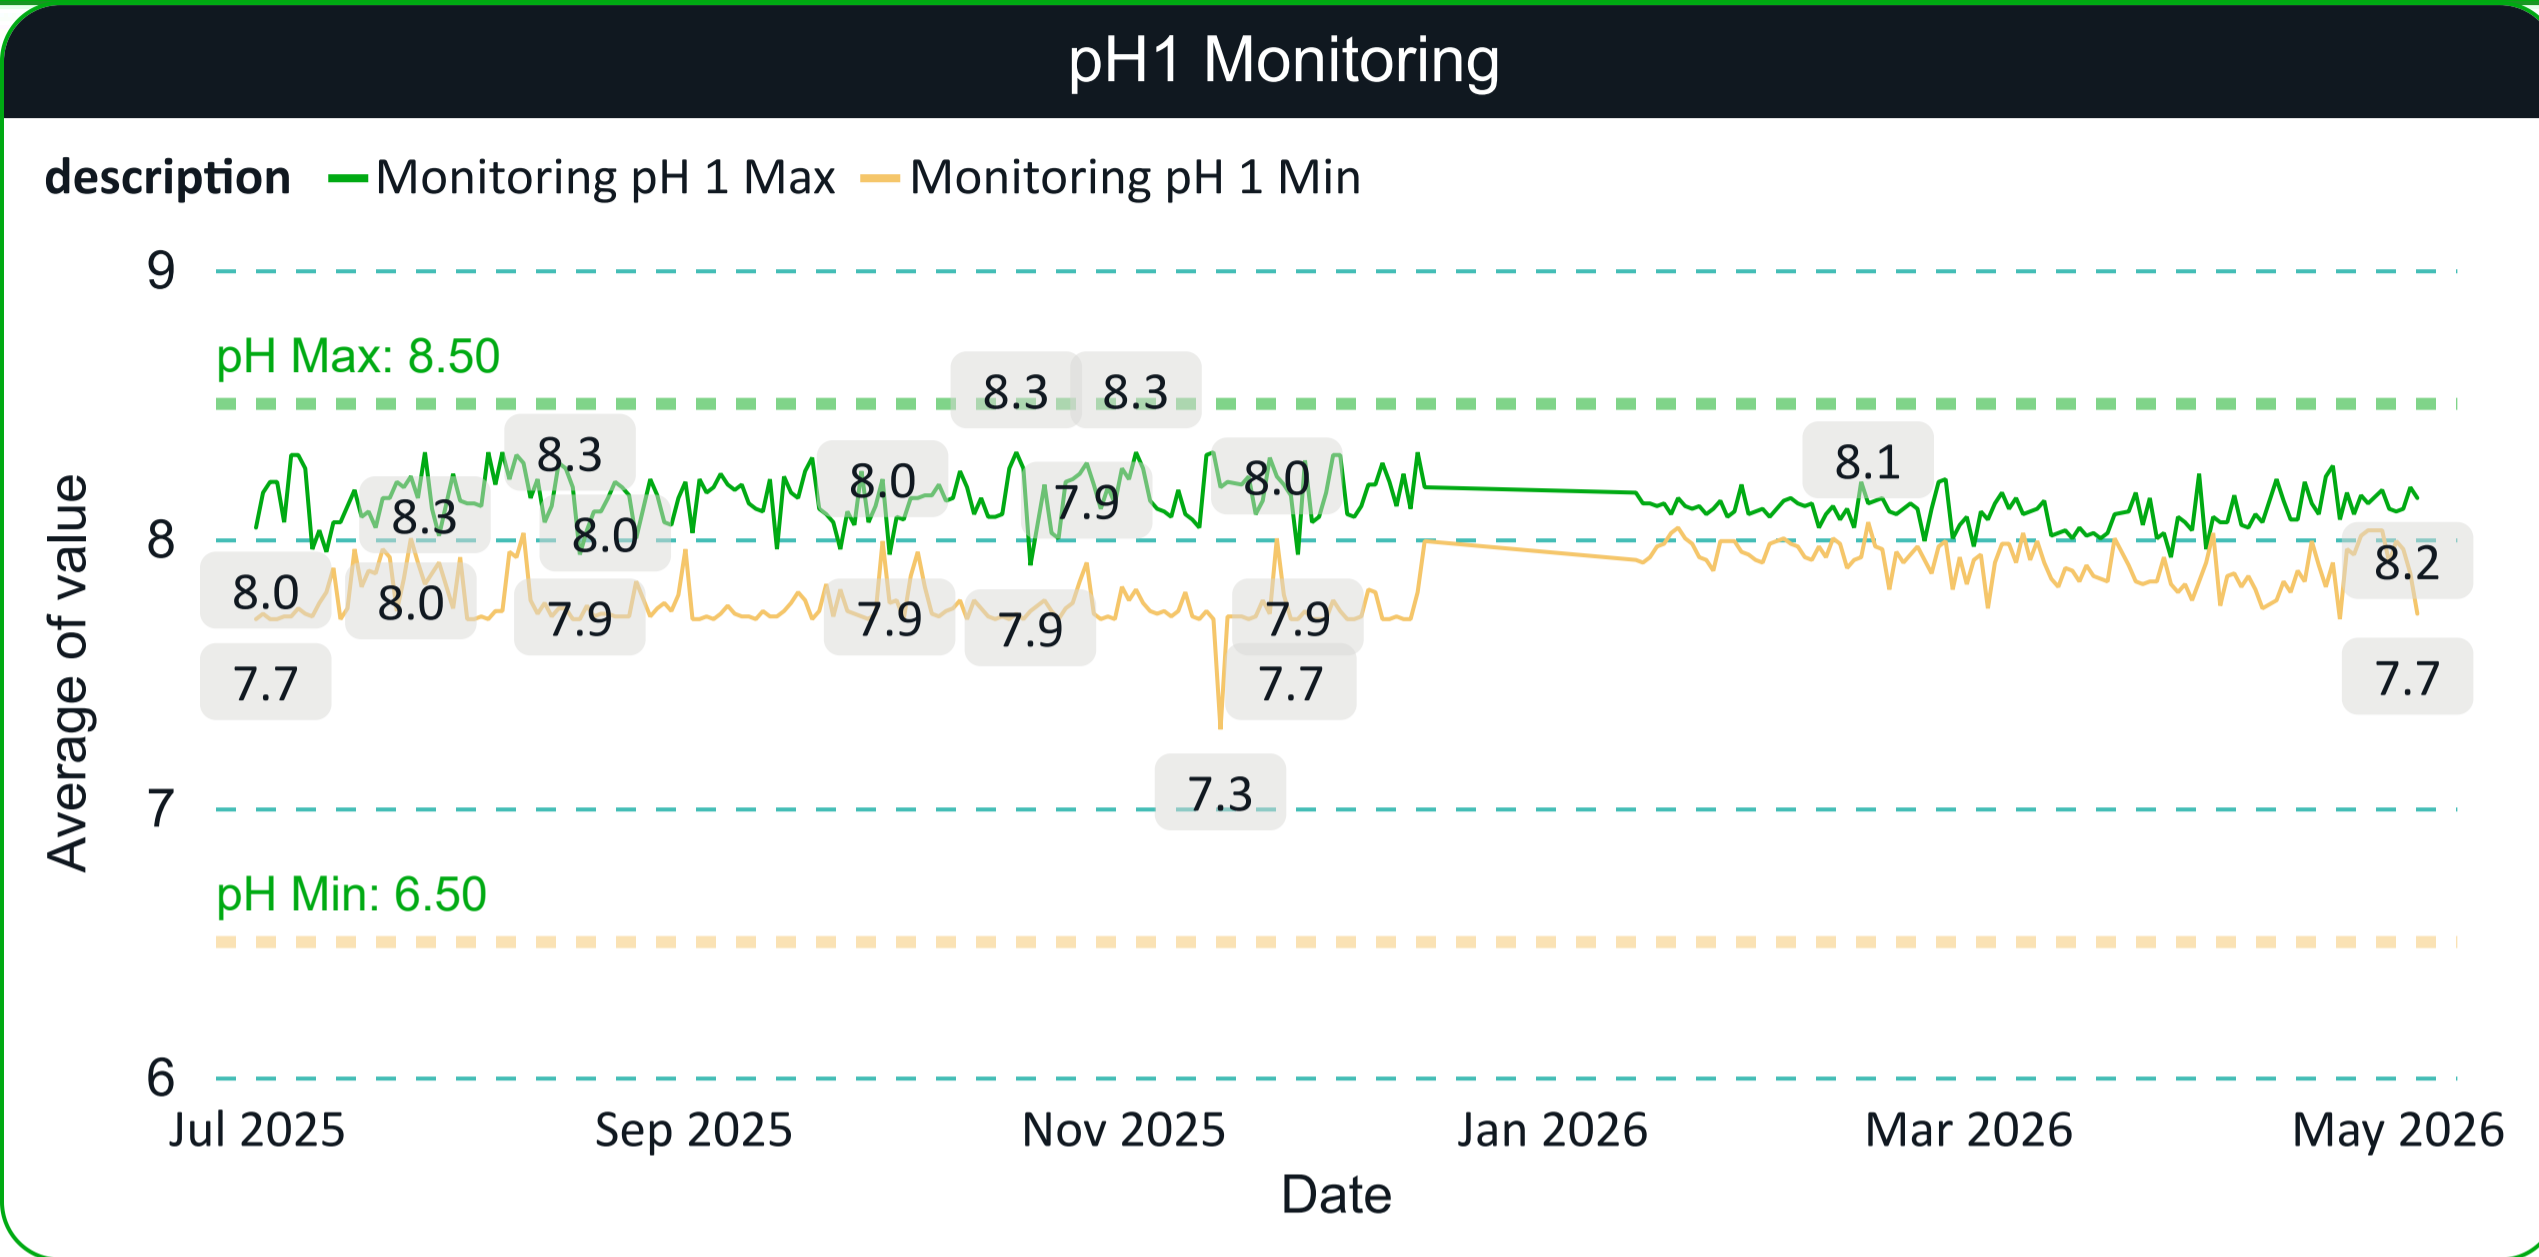

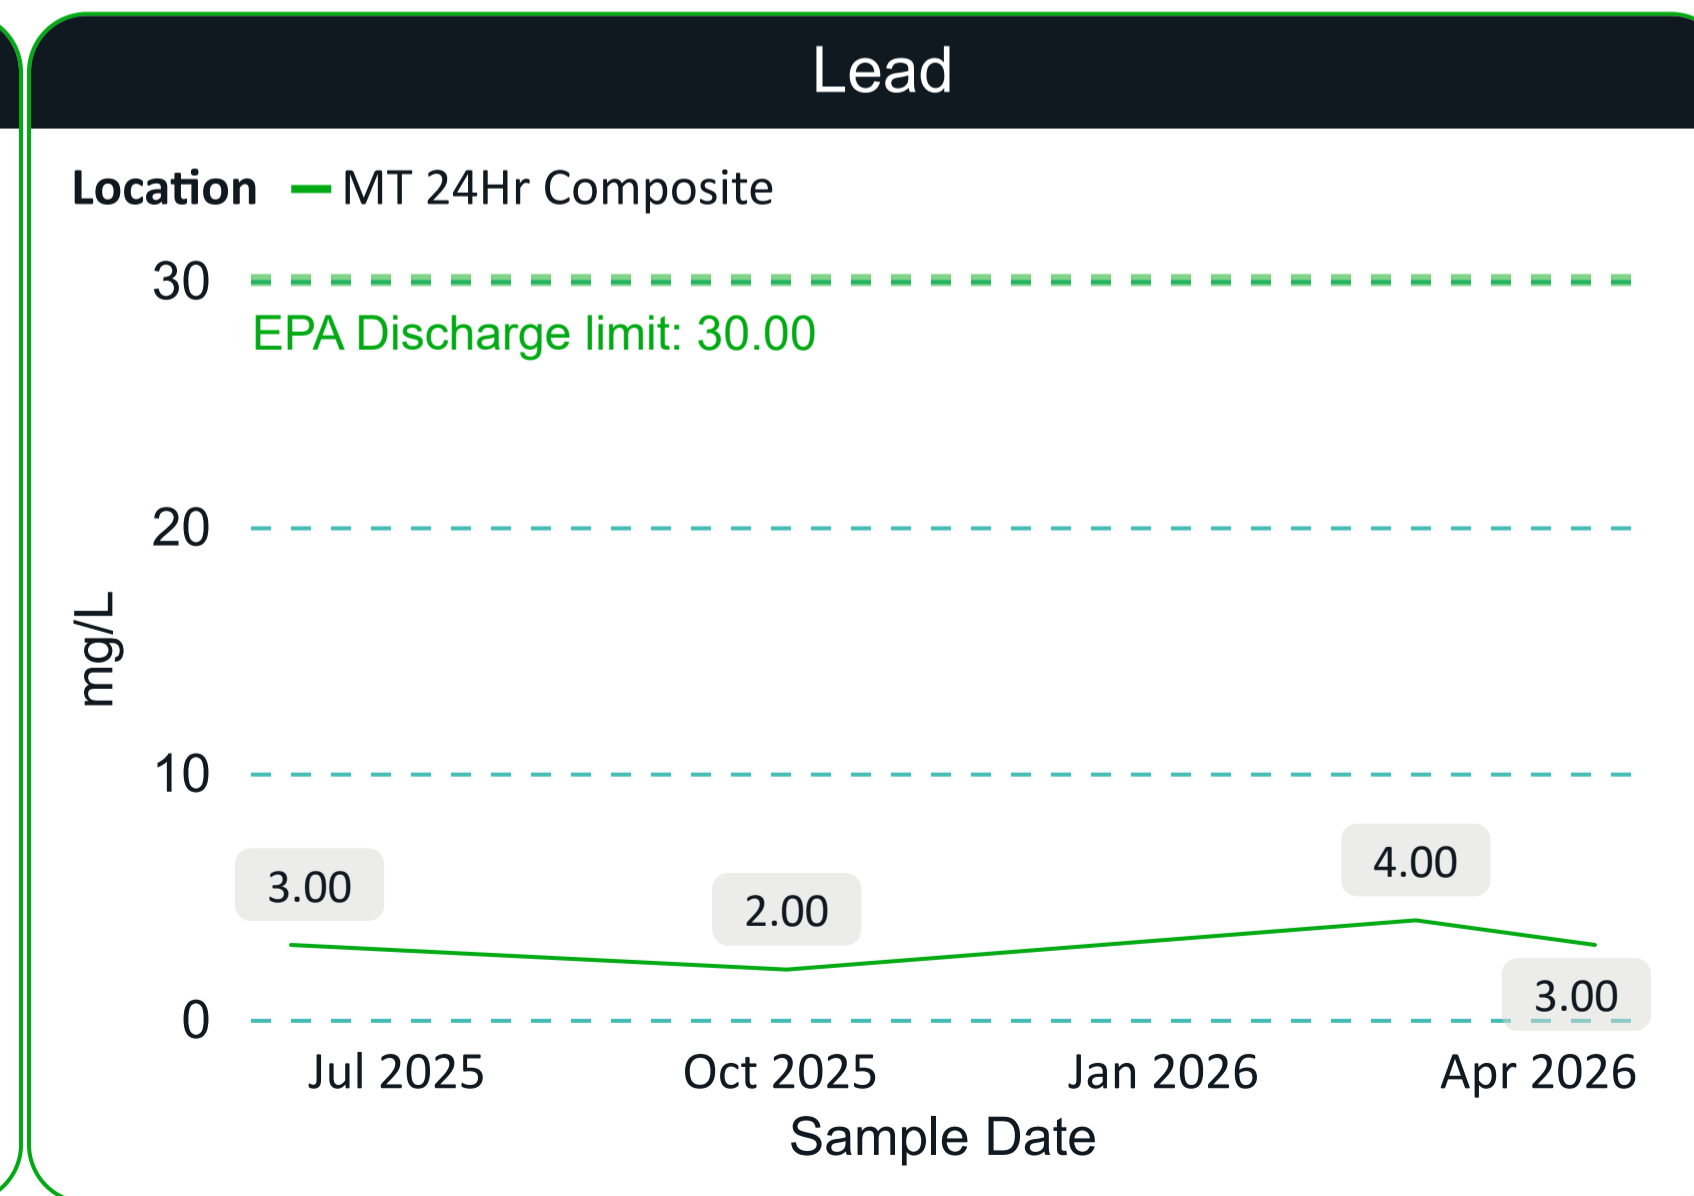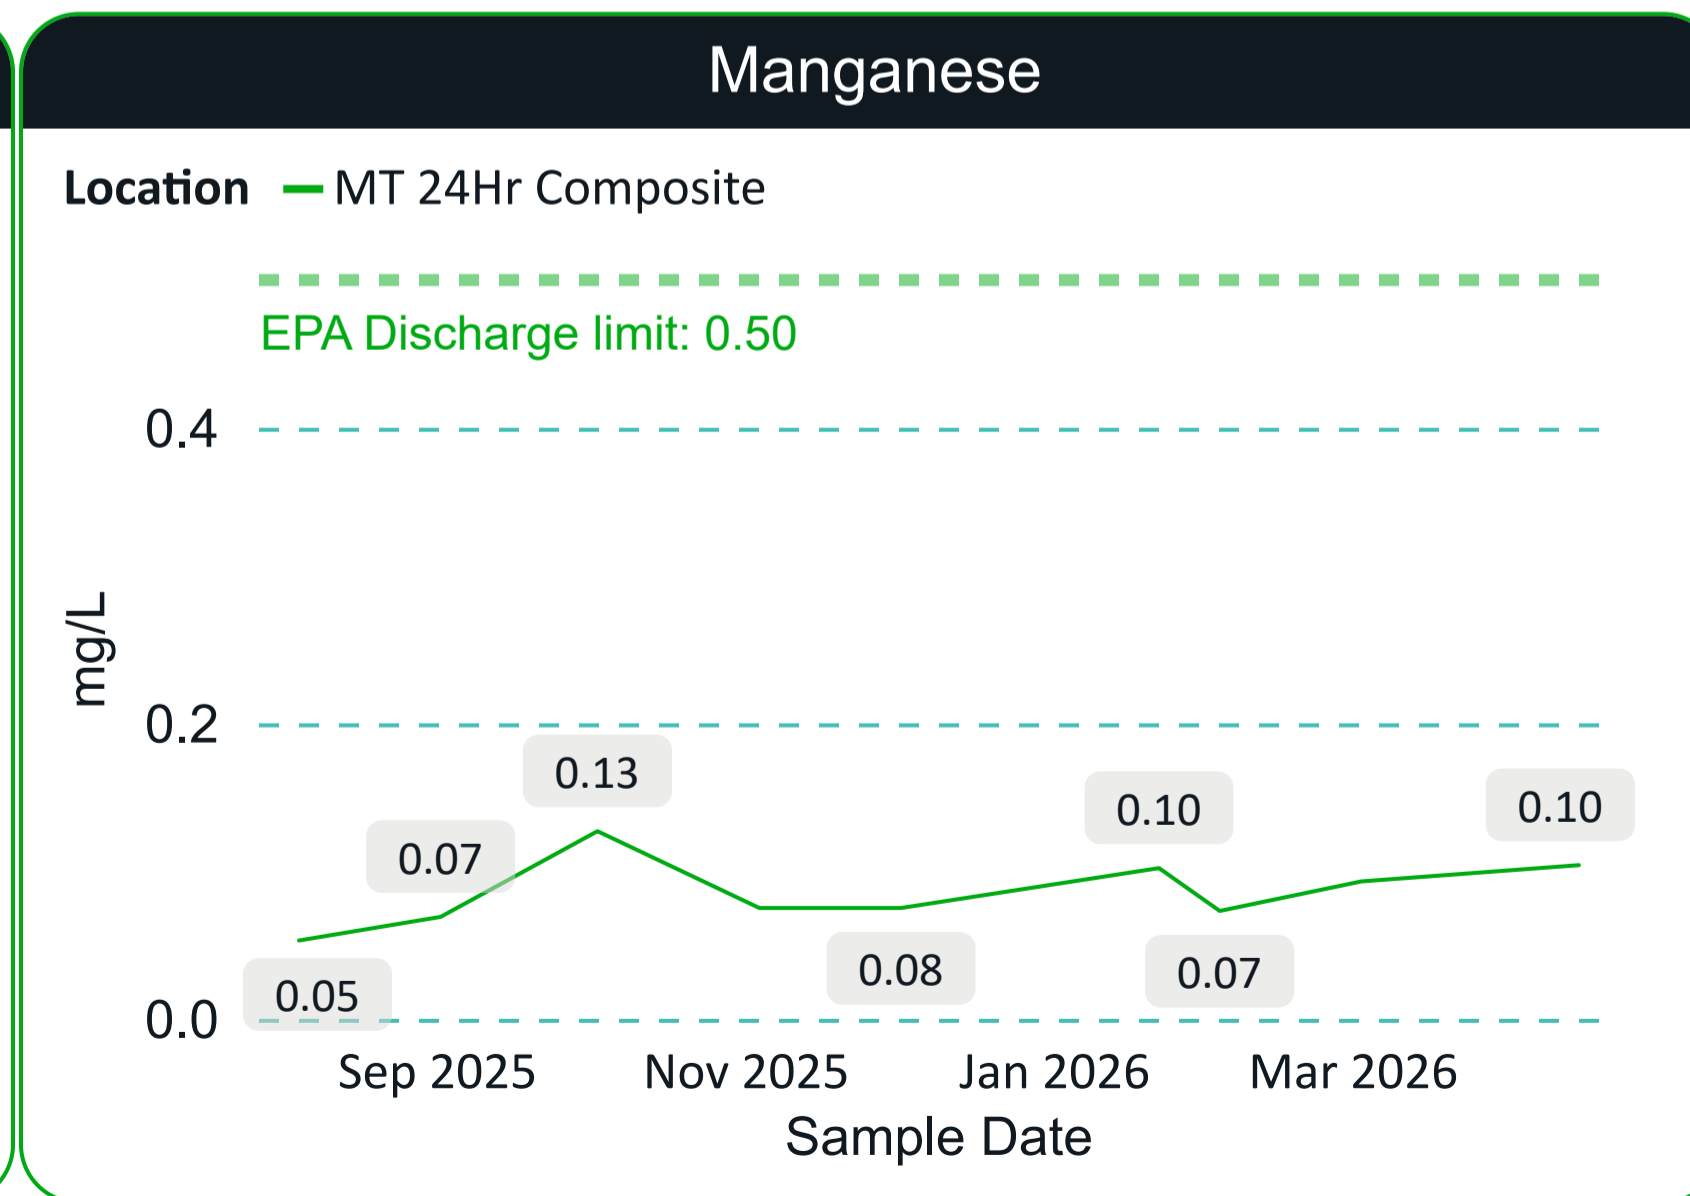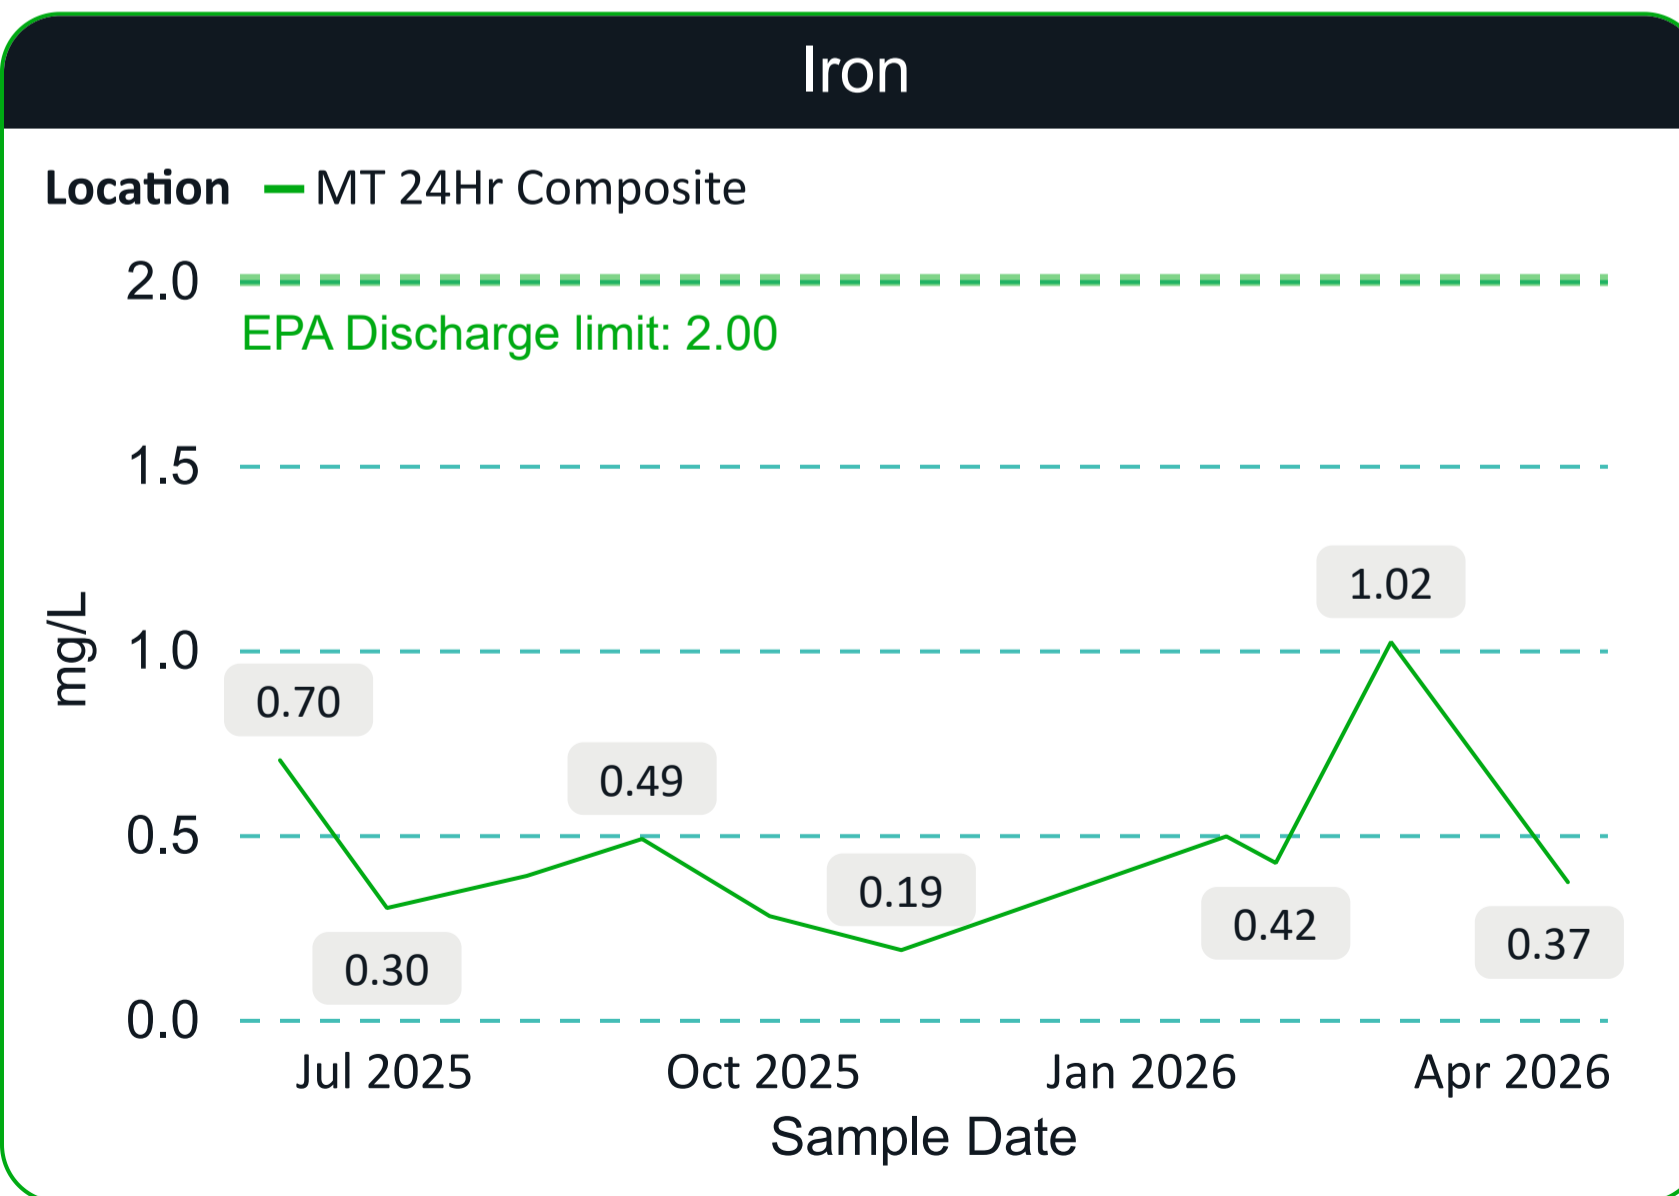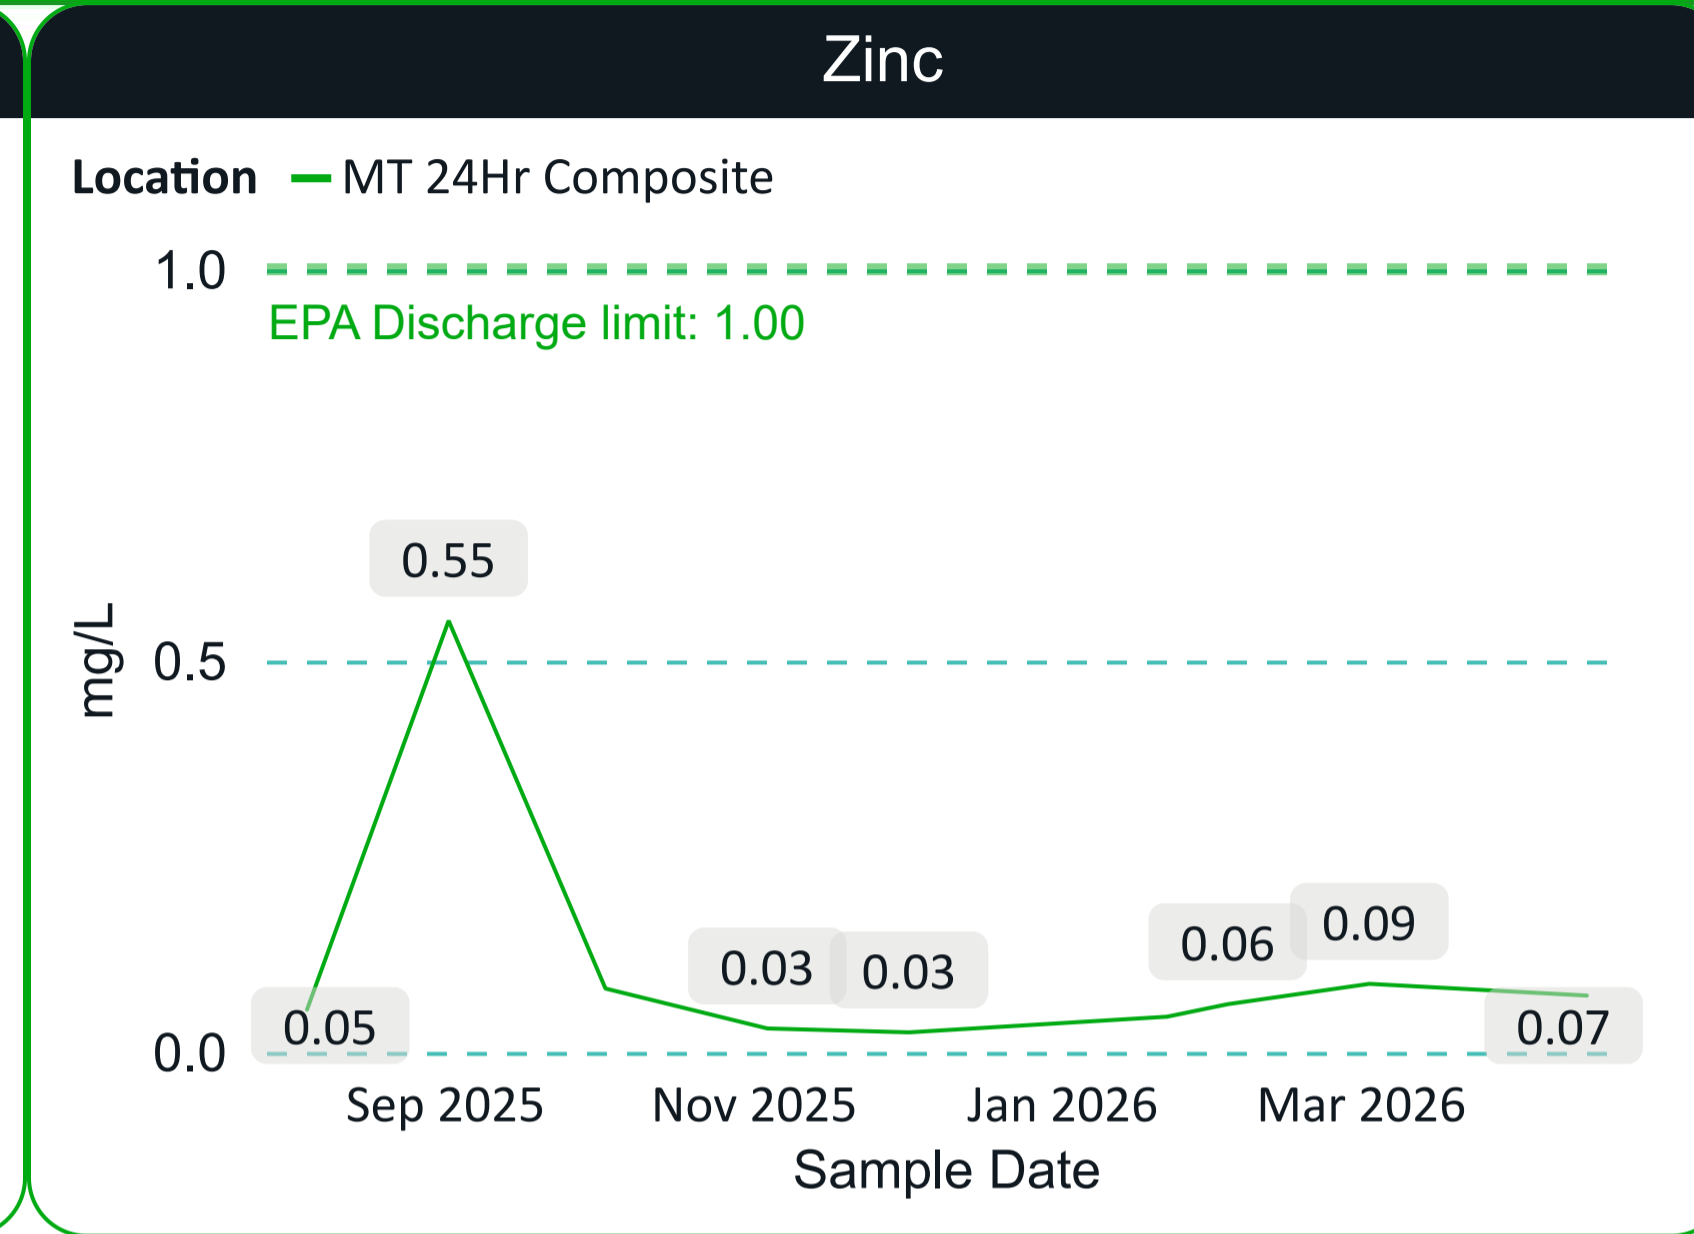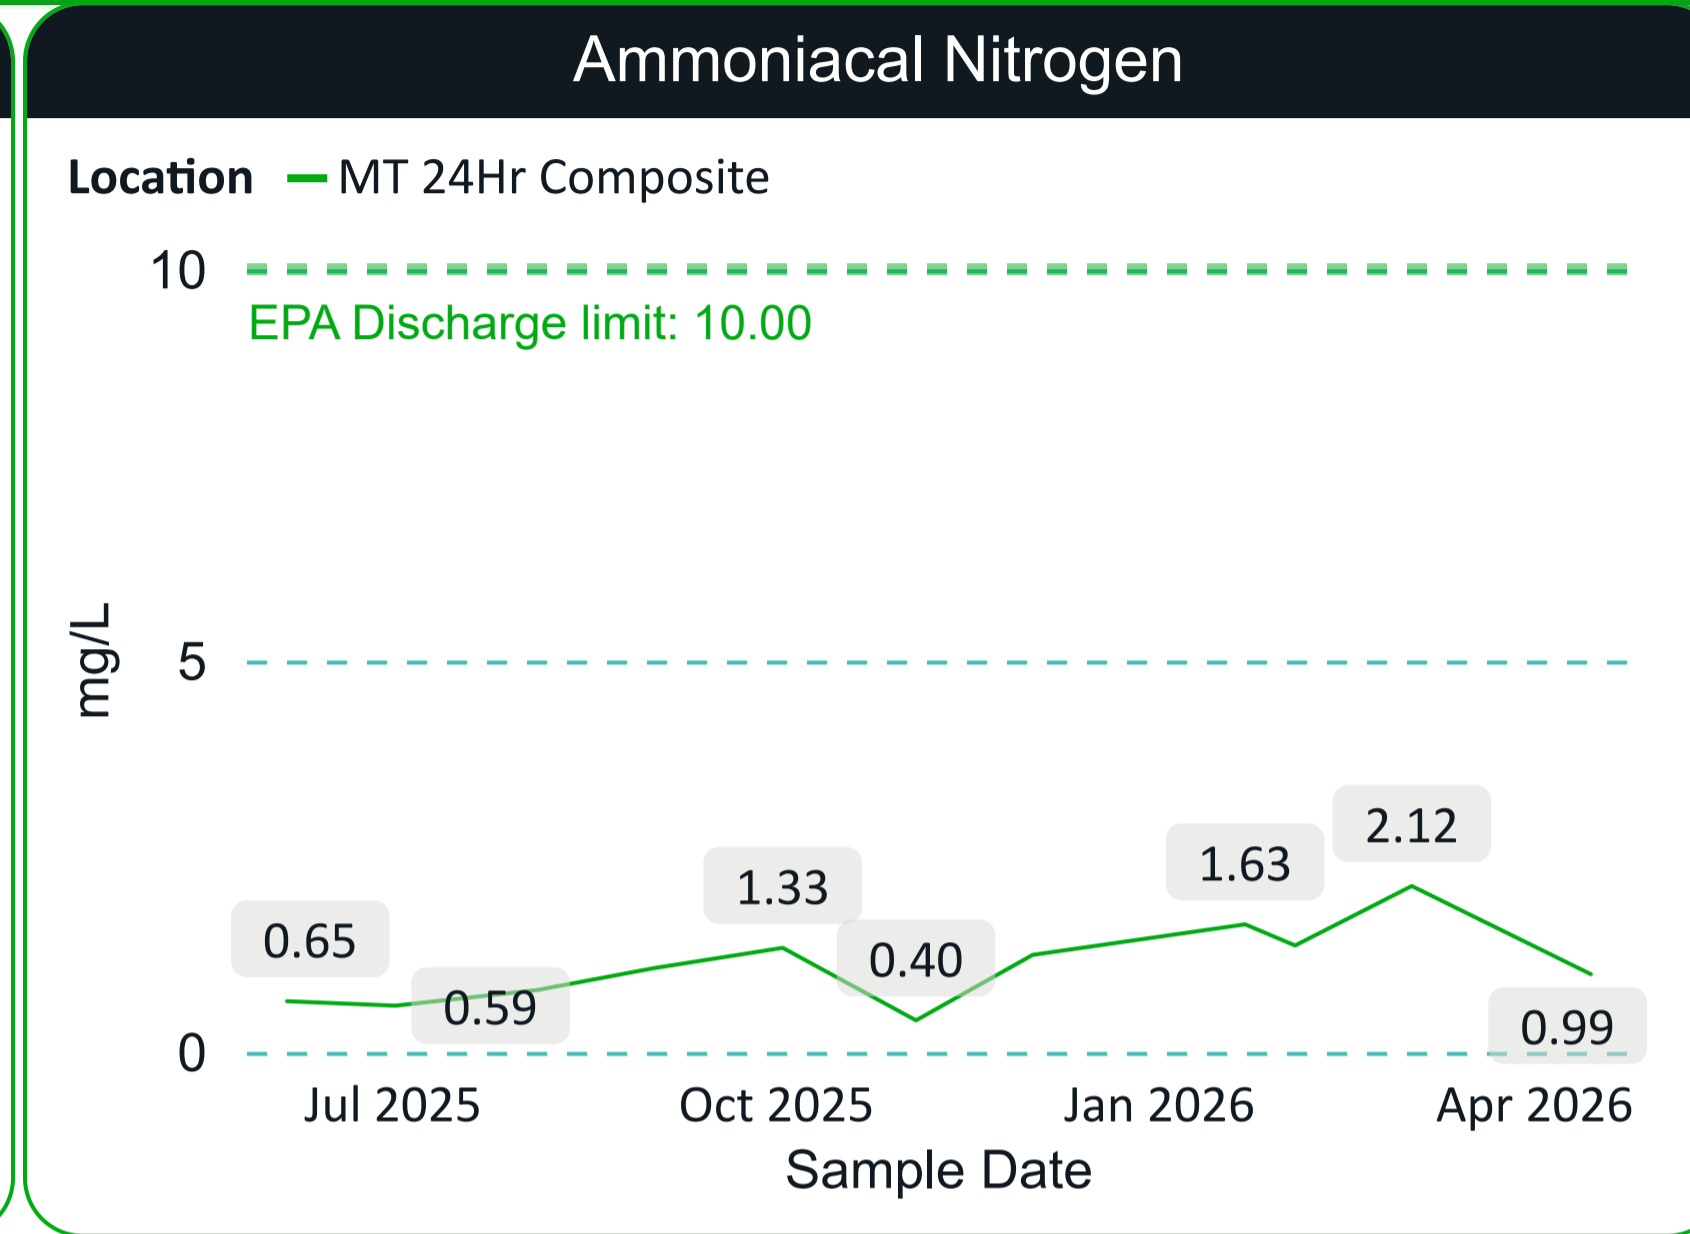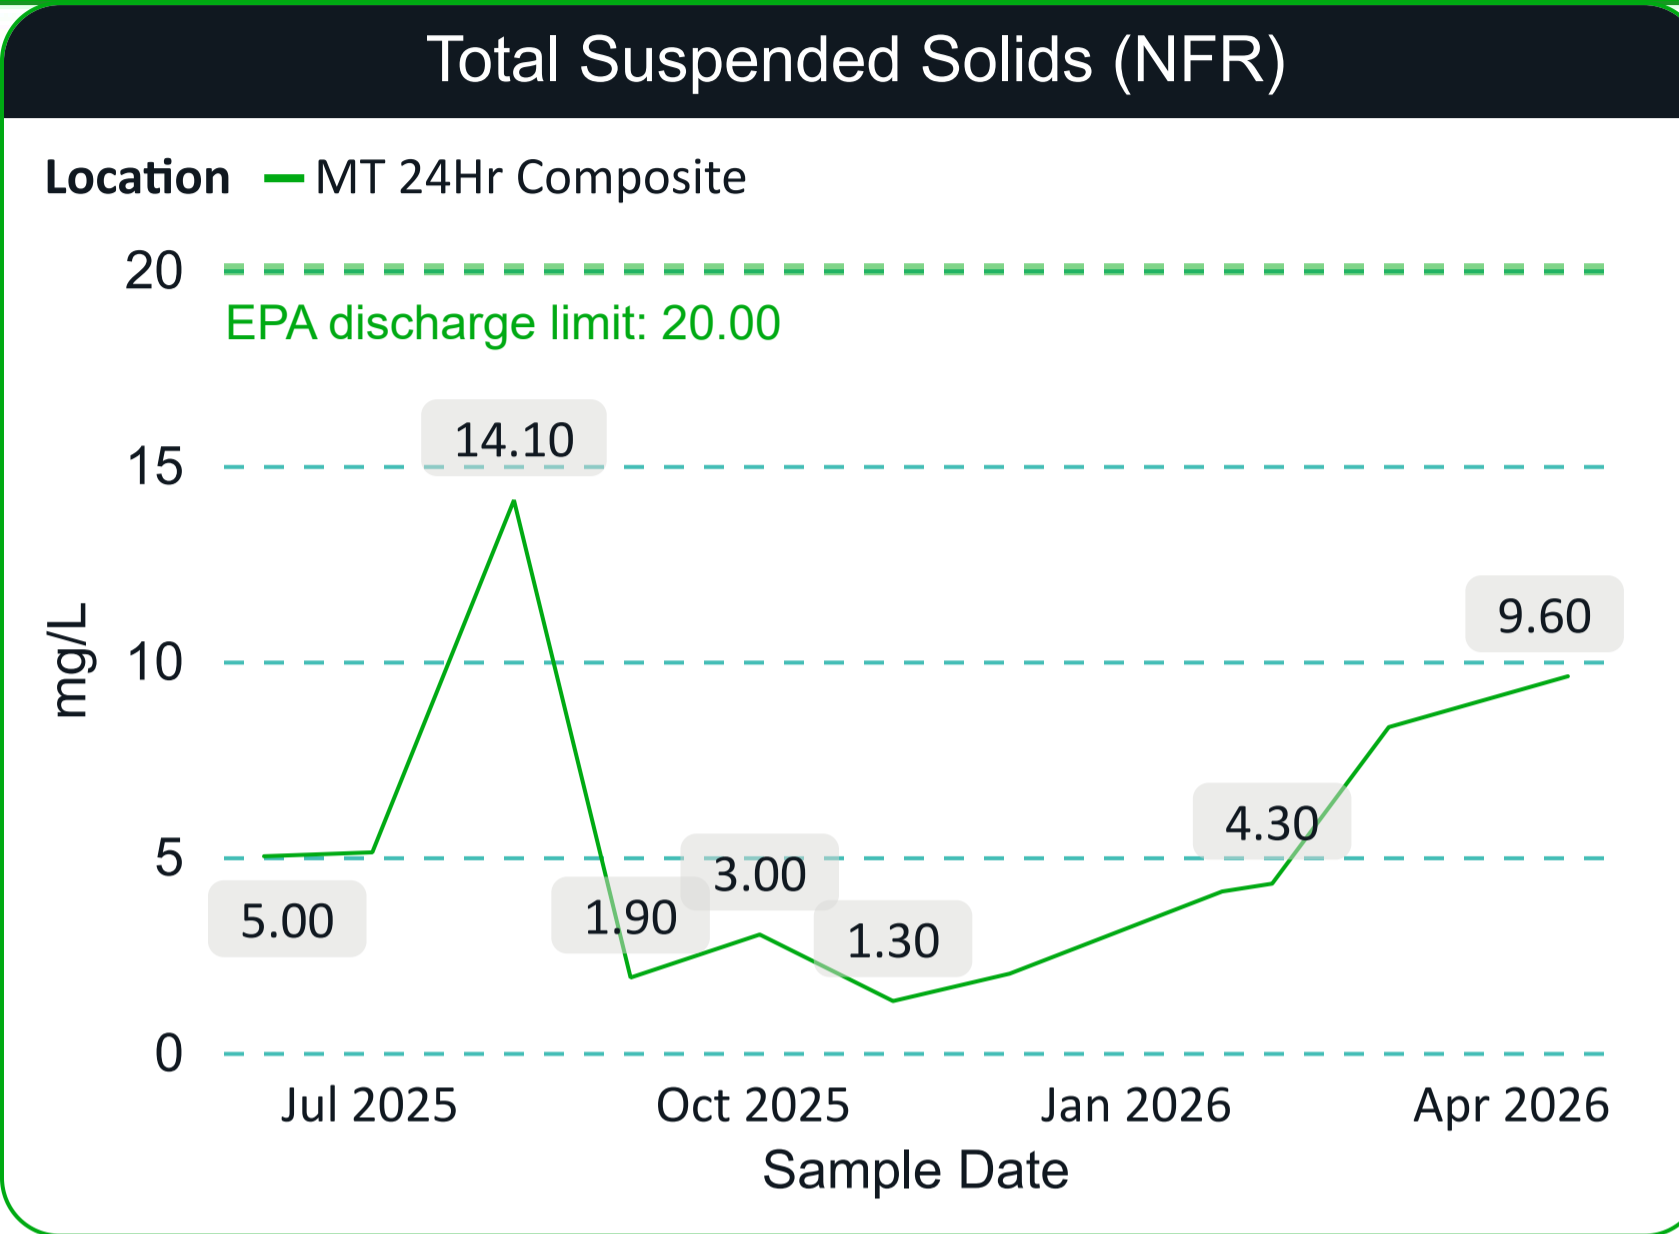

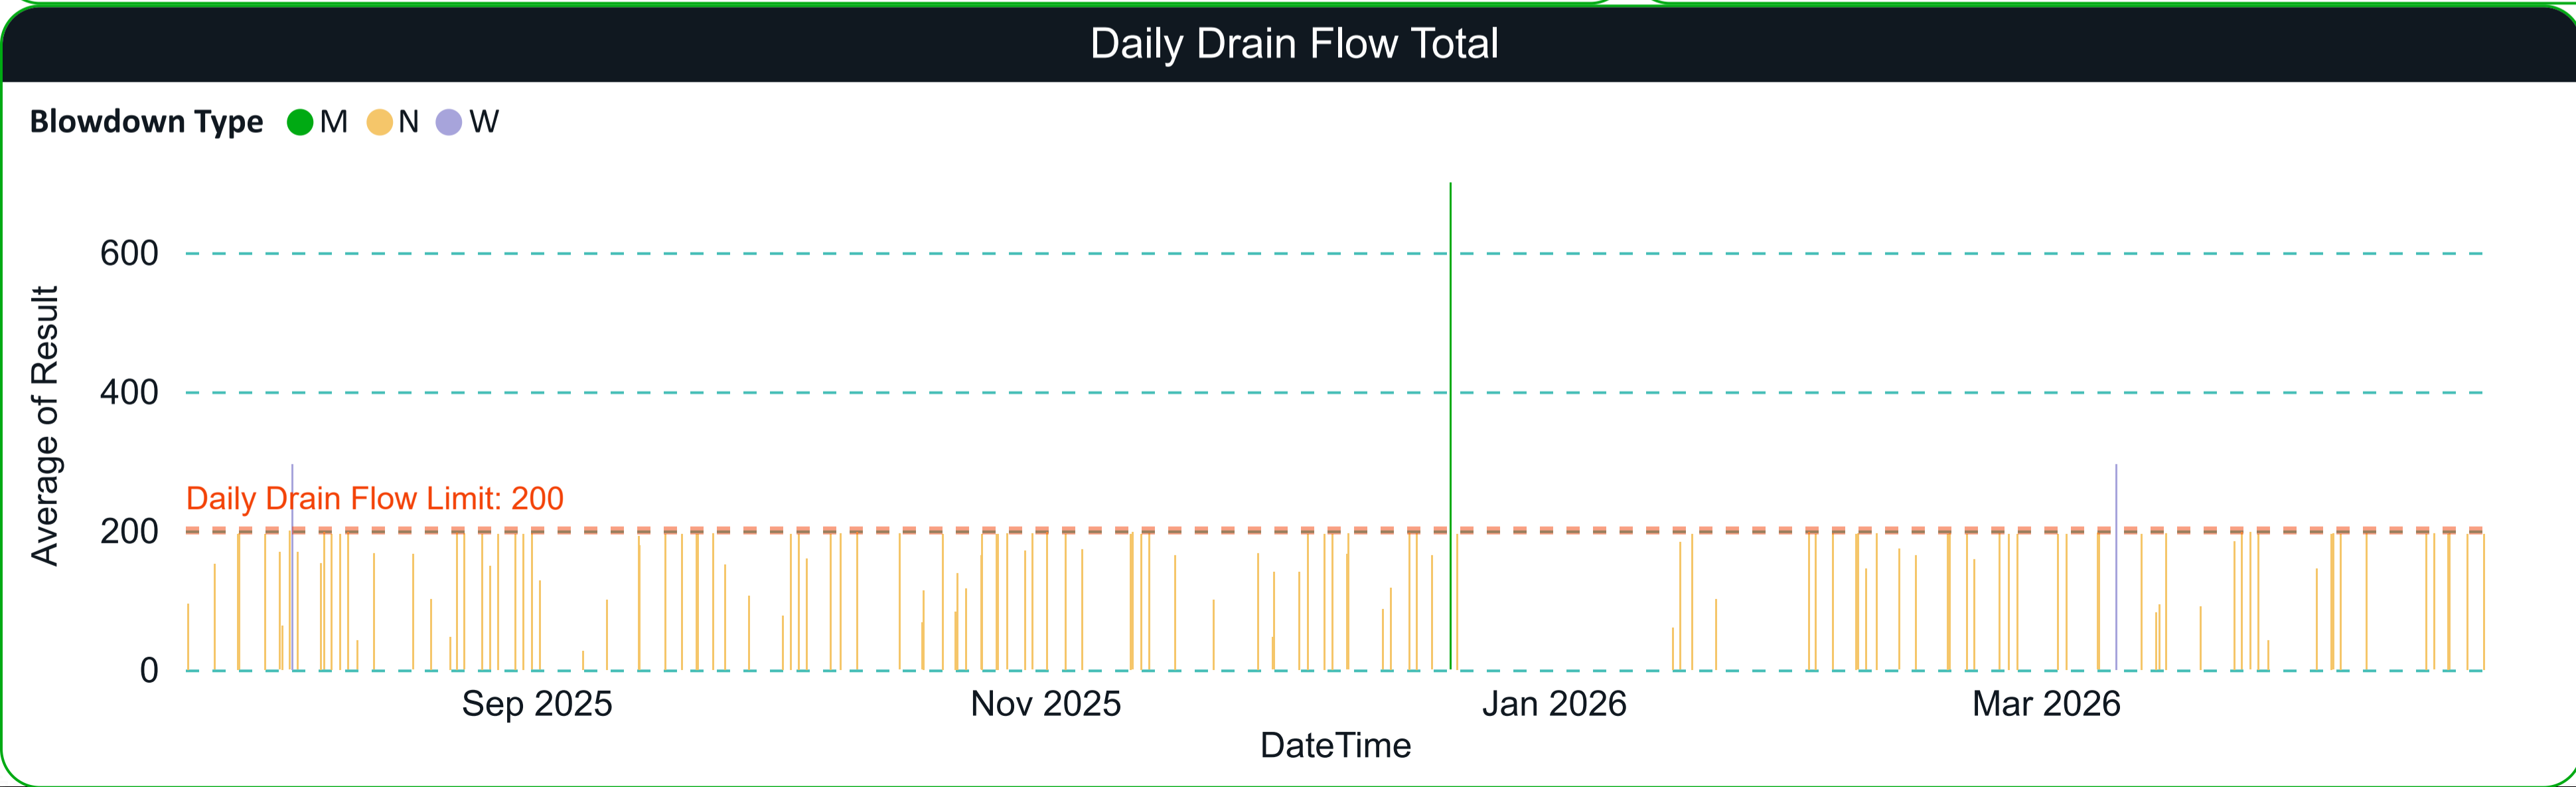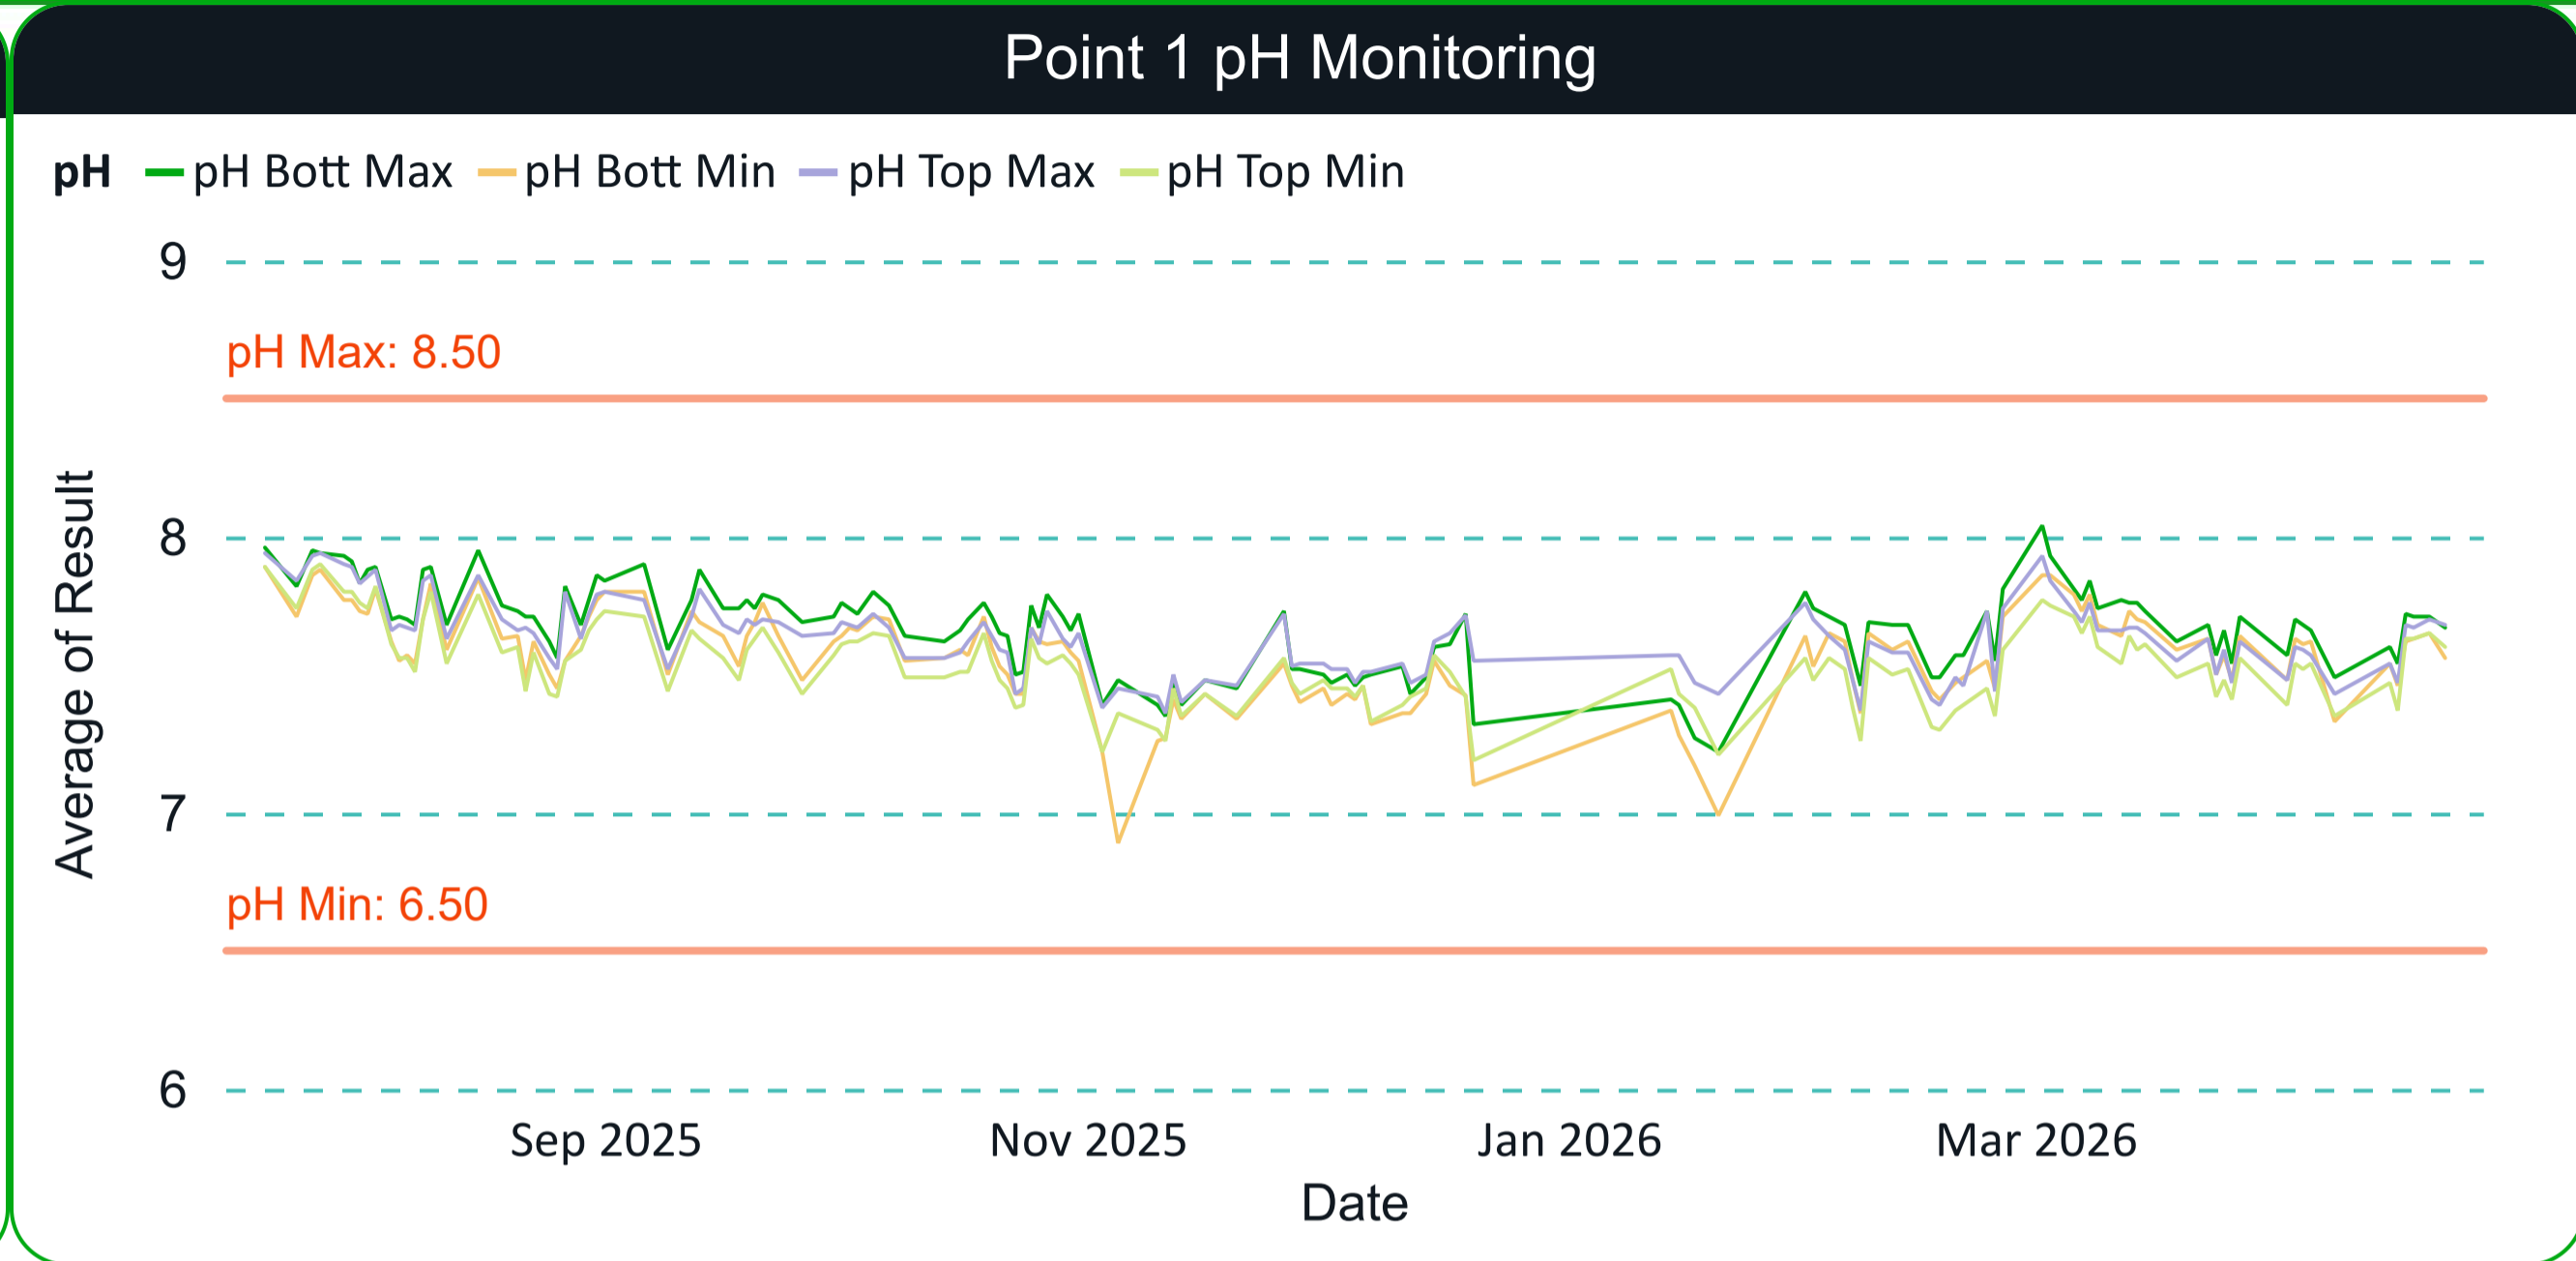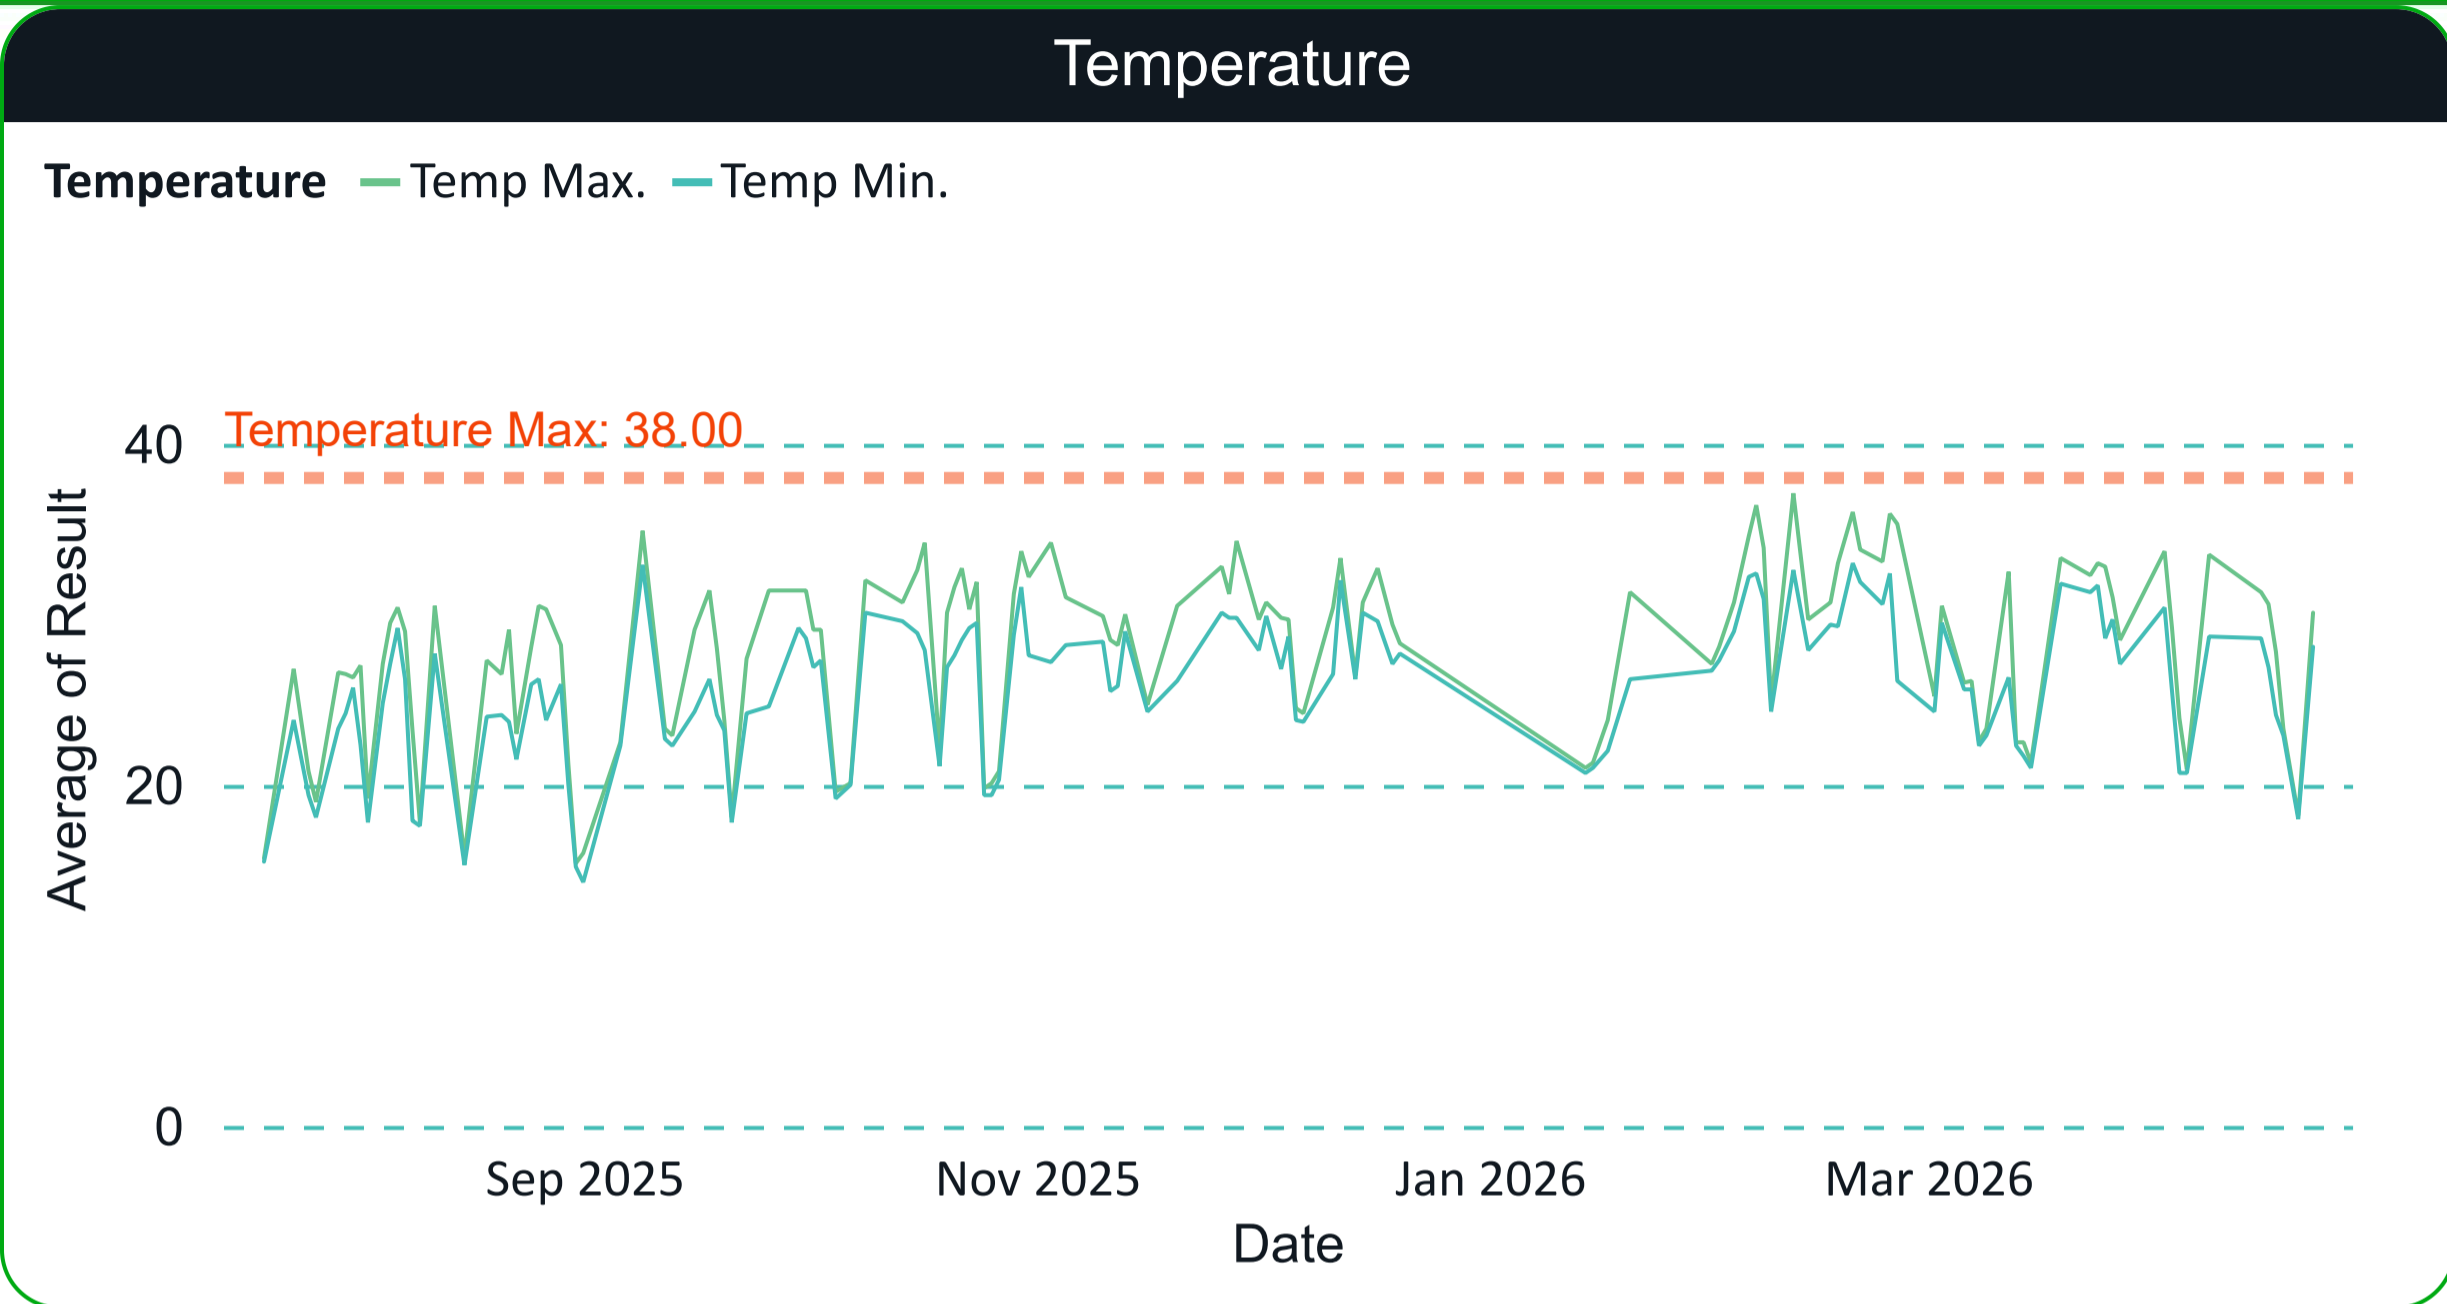

<u>Discharge Types</u>	
M	Discharges 1
N	Discharges 130
W	Discharges 2

Point 39 Licence 11149 Discharge exceptions

- M = Maintenance
- N = Normal
- W = Wet Weather
- Daily volume limit to be exceeded 12 times per year for maintenance.
- Discharge due to rainfall events of more than 10mm over a 24 hour period

